
Notes:

(1) Signal return required

(2) Cable shield terminated per wiring standards

(3) ESD protection depends on a ground suitable for dissipation of static discharge

(4) These terminals are electrically common on BB3-730x.

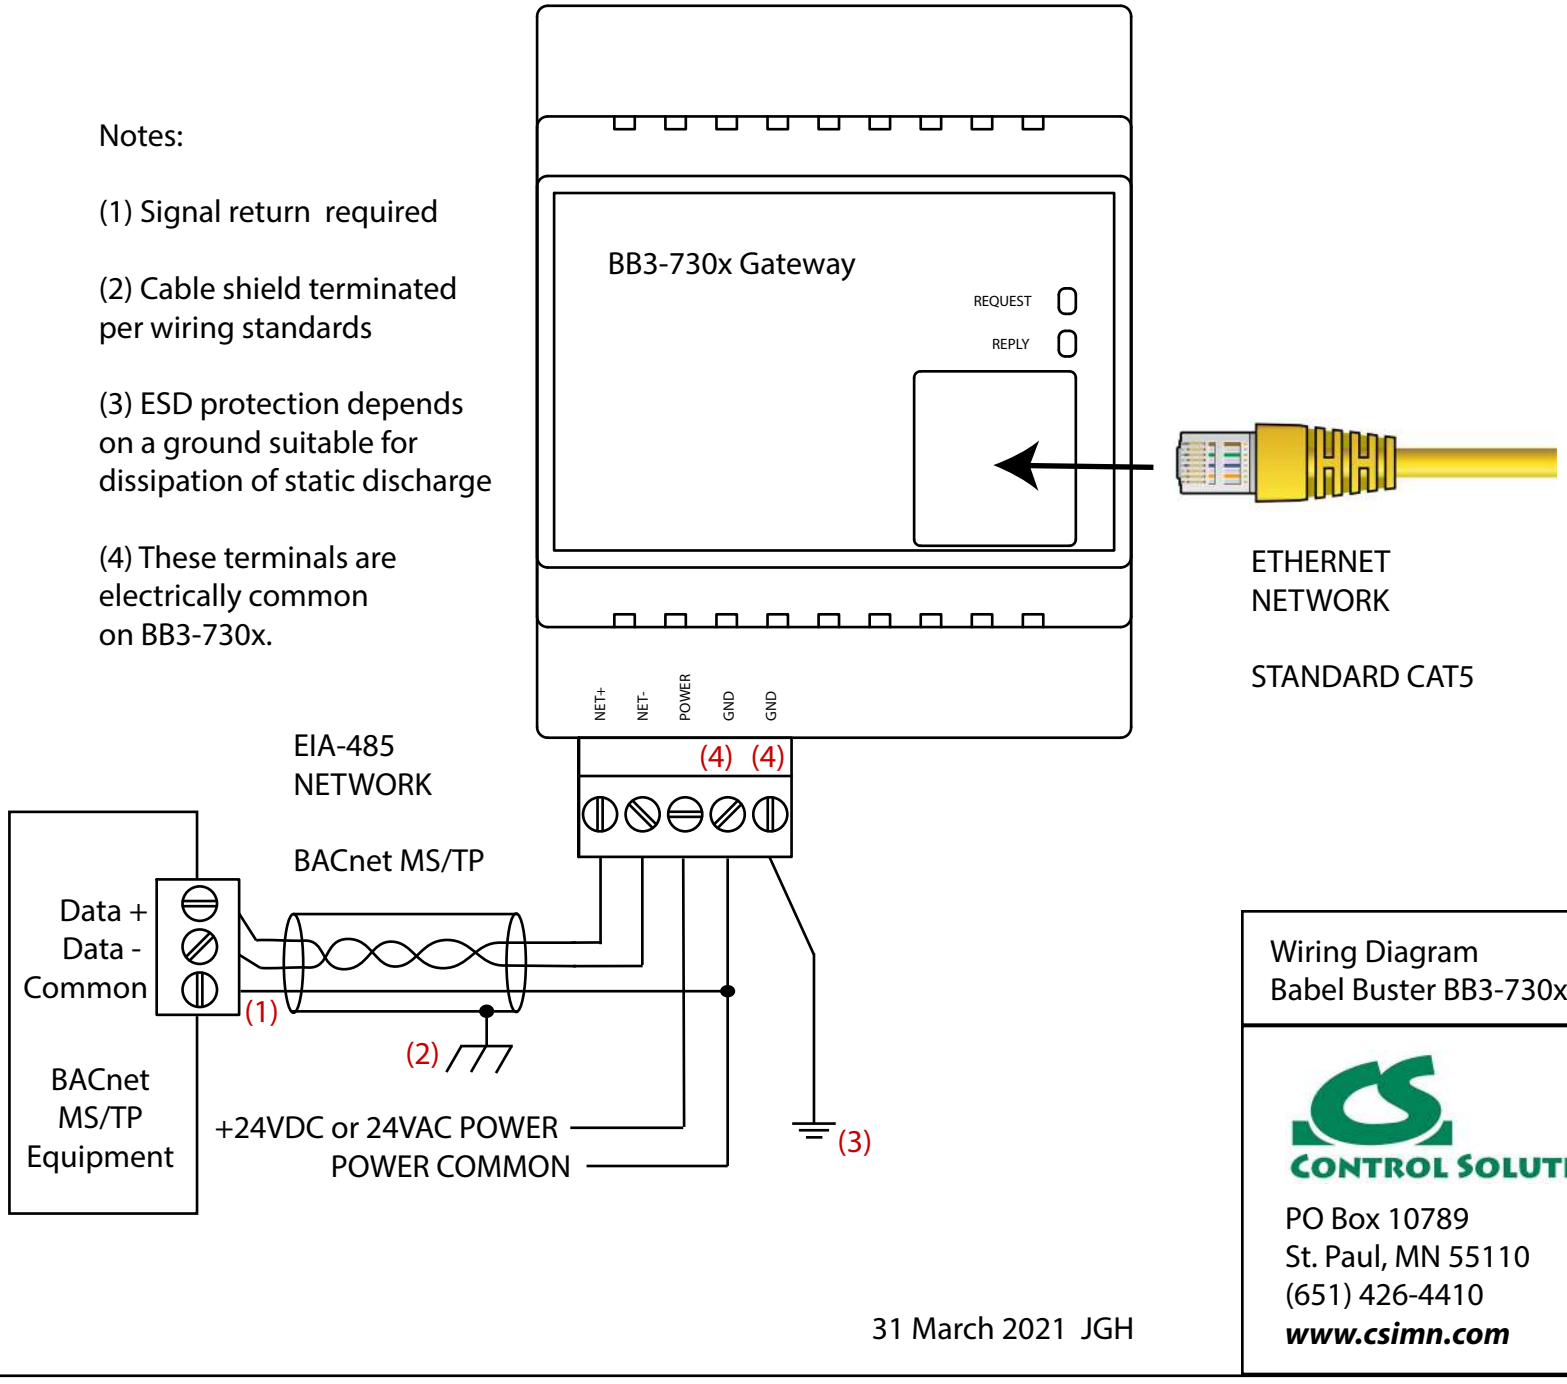

31 March 2021 JGH

Wiring Diagram
Babel Buster BB3-730x

CONTROL SOLUTIONS MINNESOTA
PO Box 10789
St. Paul, MN 55110
(651) 426-4410
www.csimn.com