

Operating Manual

EZ Gateway M-Bus to Modbus & BACnet Start-up Guide

FS-EZX-MBUS-MD-BAC

Revision: 4.B

Document No.: T18604

Print Spec: 10000005389 (EO)

MSA Safety
1000 Cranberry Woods Drive
Cranberry Township, PA 16066 USA

U.S. Support Information:
+1 408 964-4443
+1 800 727-4377
Email: smc-support@msasafety.com

EMEA Support Information:
+31 33 808 0590
Email:
smc-support.emea@msasafety.com

For your local MSA contacts, please go to our website www.MSAsafety.com

© MSA 2024. All rights reserved

Contents

1 About the EZ Gateway 5
1.1 Certification 5
1.2 Supplied Equipment 5

2 Equipment Setup 6
2.1 Mounting 6
2.2 Physical Dimensions 7

3 Installing the EZ Gateway 8
3.1 M-Bus Connection R2 Port 8
3.1.1 RS-485 Connection R1 Port 8
3.2 R1 Port Small DIP Switches 9

4 Operation 10
4.1 Power Up the Device 10
4.2 Connect the PC to the EZ Gateway Over the Ethernet Port 10
4.3 Access EZ Gateway Using a Web Browser 10

5 Setup Web Server Security 11
5.1 Login to the FieldServer 11
5.2 Select the Security Mode 13
5.2.1 HTTPS with Own Trusted TLS Certificate 14
5.2.2 HTTPS with Default Untrusted Self-Signed TLS Certificate or HTTP with Built-in Payload Encryption 14

6 Configuring the EZ Gateway 15
6.1 M-Bus Settings 16
6.2 BMS Settings 17
6.2.1 BACnet/IP and BACnet MS/TP 17
6.2.2 Modbus TCP/IP and Mobus RTU 19
6.3 Network Settings 20

7 Using the EZ Gateway 21
7.1 Find Devices Using M-Bus Explorer Page 21
7.2 Create a Profile from a Discovered Device 24
7.3 Manage Profiles Using the Device Profiles Page 28
7.3.1 Import Button 28
7.3.2 Edit Button 29
7.3.3 Delete Button 30
7.3.4 Export Button 30
7.4 Load a Profile Instance Using M-Bus Explorer 31
7.5 View Live Data Using Live View 33
7.6 Diagnostics and Cloud Connection 35
7.6.1 Accessing the FieldServer Manager 35

8 Troubleshooting 36
8.1 Communicating with the EZ Gateway Over the Network 36
8.2 Notes Regarding Subnets and Subnet Masks 36
8.3 Taking a FieldServer Diagnostic Capture 37
8.4 LED Functions 38
8.5 Internet Browser Software Support 38
8.6 Stalled Discovery 39

9 Additional Information 40
9.1 Change Web Server Security Settings After Initial Setup 40
9.1.1 Change Security Mode 41

9.1.2 Edit the Certificate Loaded onto the FieldServer 42
9.2 Change User Management Settings 43
9.2.1 Create Users 44
9.2.2 Edit Users 45
9.2.3 Delete Users 46
9.2.4 Change FieldServer Password 46
9.3 Specifications 47
9.4 Warnings 47
9.5 Compliance with EN IEC 62368-1 47

10 Limited 2 Year Warranty 48

1 About the EZ Gateway

The EZ Gateway is a high performance, cost effective Building and Industrial Automation multi-protocol gateway providing protocol translation between serial/Ethernet devices and networks.

NOTE: For troubleshooting assistance refer to Section 8 Troubleshooting, or any of the troubleshooting appendices in the related driver supplements. Check the MSA Safety website for technical support resources and documentation that may be of assistance.

The EZ Gateway is cloud ready and connects with MSA Safety's Grid. See **Section** for further information.

1.1 Certification

BTL Mark – BACnet Testing Laboratory

The BTL Mark on the FieldServer is a symbol that indicates that a product has passed a series of rigorous tests conducted by an independent laboratory which verifies that the product correctly implements the BACnet features claimed in the listing. The mark is a symbol of a high-quality BACnet product.

Go to www.BACnetInternational.net for more information about the BACnet Testing Laboratory. Click here for the BACnet PIC Statement. *BACnet is a registered trademark of ASHRAE*.

1.2 Supplied Equipment

FieldServer Gateway

- Preloaded with the M-Bus, Modbus and BACnet drivers.
- All instruction manuals, driver manuals, support utilities are available on the USB drive provided in the optional accessory kit, or on the MSA Safety website.

Accessory kit (optional) (Part # FS-8915-38-QS) includes:

- 7-ft Cat-5 cable with RJ45 connectors at both ends
- Power Supply -110/220V (p/n 69196)
- DIN rail mounting bracket
- Screwdriver for connecting to terminals
- USB Flash drive loaded with:
  - Start-up Guide
  - FieldServer Configuration Manual
  - All FieldServer Driver Manuals
  - Support Utilities
  - Any additional folders related to special files configured for a specific FieldServer
  - Additional components as required - see driver manual supplement for details

2 Equipment Setup


2.1 Mounting

The following mounting options are available:

- Product comes with tabs for wall or surface mount. These can be snapped off if not required.


NOTE: The tab has a hole that is .169" diameter. Use the appropriate size of screw for mounting.

- DIN rail mounting bracket – Included in the accessory kit or ordered separately (part # FS-8915-35-QS).

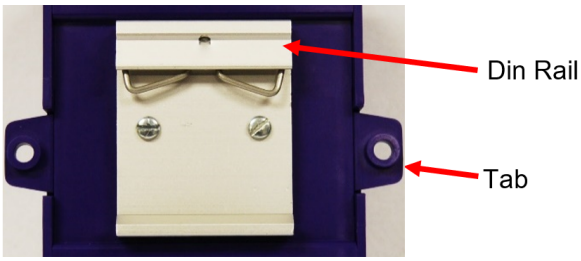

WARNING: Install only as instructed, failure to follow the installation guidelines or using screws without the DIN rail mounting bracket could result in permanent damage to the product. If the FieldServer is removed from the DIN rail, use the original screws to reattach. Only screws supplied by MSA Safety should be used in the holes found on the back of the unit when attaching the optional DIN Rail bracket. USE OF ANY OTHER SCREWS MAY DAMAGE THE UNIT.


2.2 Physical Dimensions

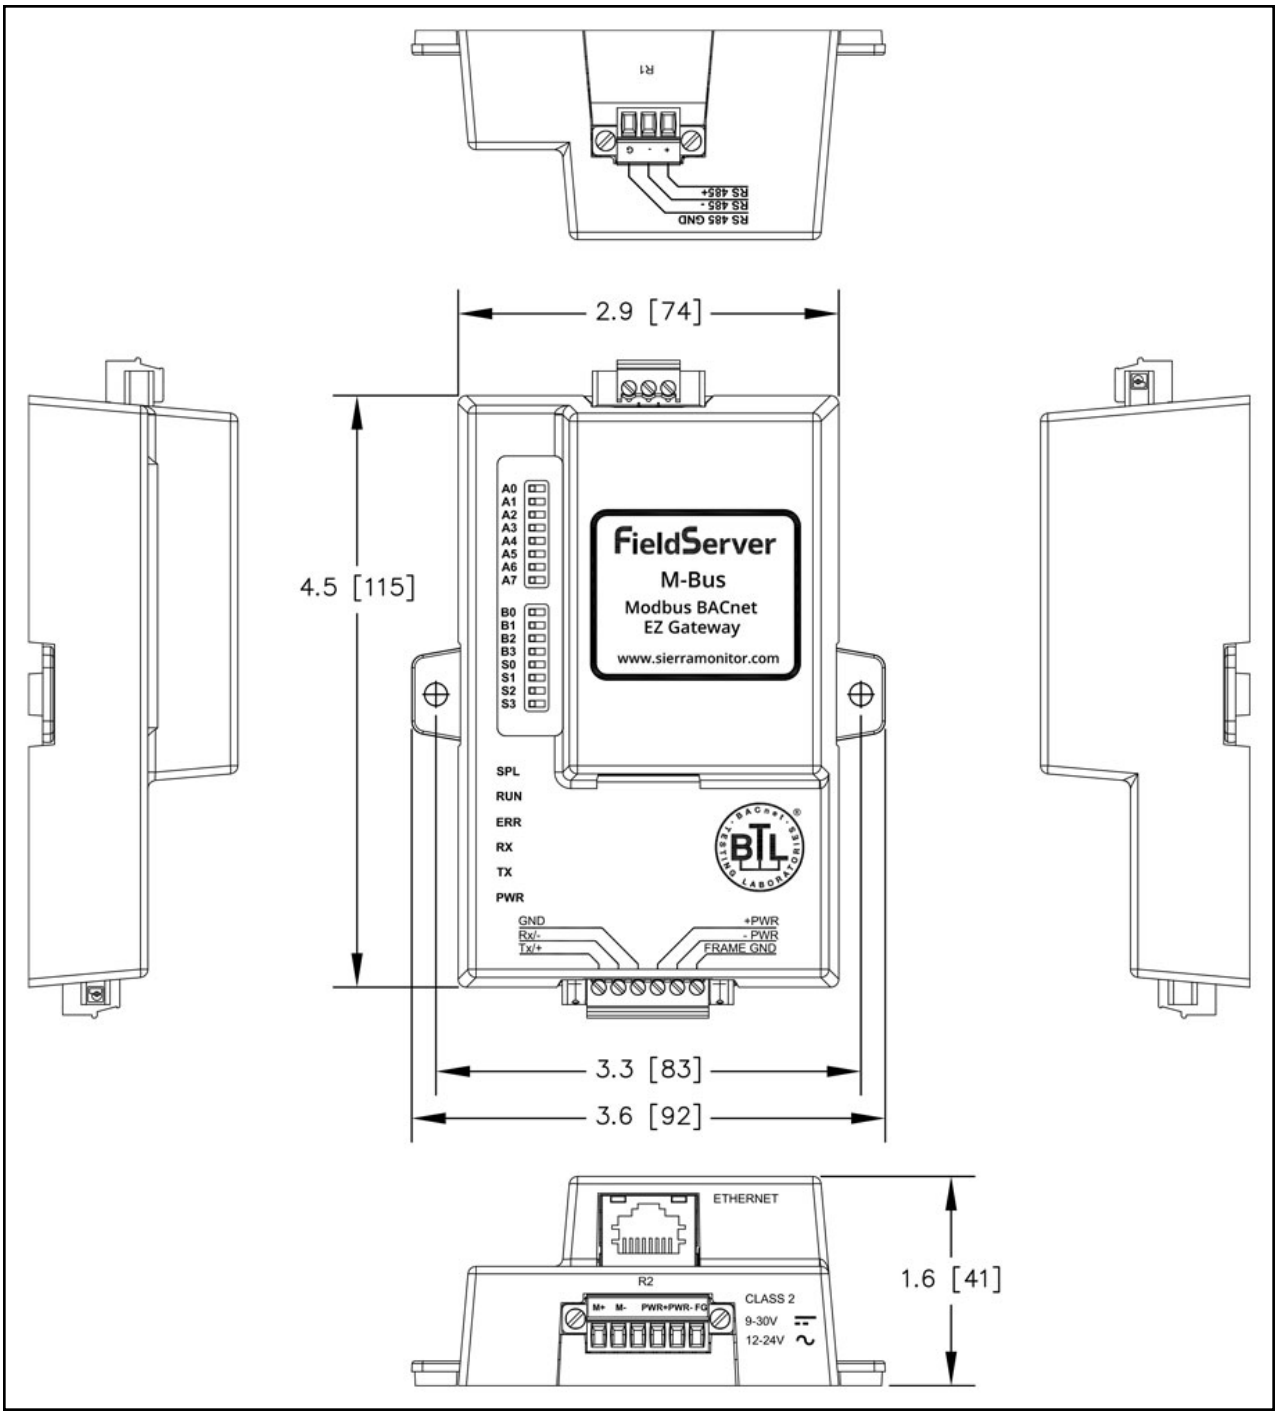

3 Installing the EZ Gateway

3.1 M-Bus Connection R2 Port

The EZ Gateway M-Bus to Modbus & BACnet is used to transfer data to and from devices using protocols. The M-Bus driver enables data access from M-Bus networks to other FieldServer protocols. Most M-Bus data-point types are supported, allowing communication to almost any kind of M-Bus device in an installation, such as utility meters, energy meters, flow meters, temperature & humidity sensors, etc. This allows BMS systems to access an M-Bus network using direct read the M-Bus points. The EZ Gateway is intended to act as a master (to read slave devices) or a slave (to emulate other single or multiple slave devices) to make the information available to other protocols.

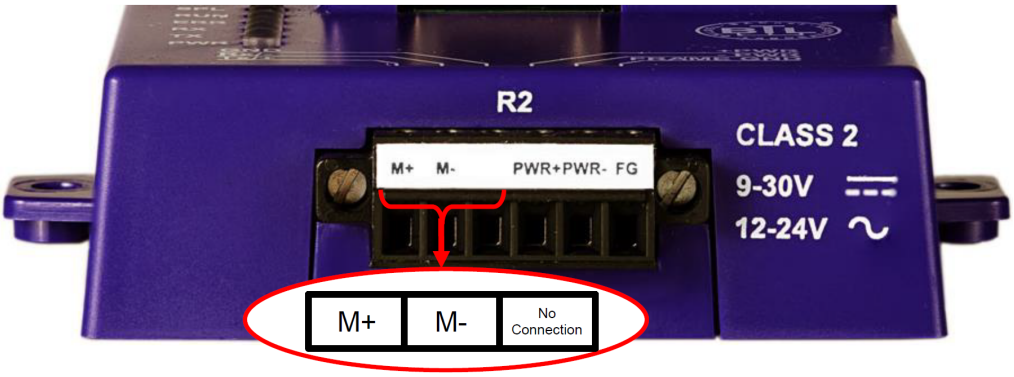

The M-Bus connection consists of an M + and M- terminal. Most M-Bus devices are not polarity sensitive, but please verify the polarity before connecting any devices.

The following Baud Rates are supported on the R2 Port for M-Bus:
2400, 4800, 9600, 19200, 38400

3.1.1 RS-485 Connection R1 Port

Connect to the 3-pin connector as shown.



The following baud rates are supported on the R1 Port for Modbus RTU:


2400, 4800, 9600, 19200, 38400, 57600, 76800, 115200

The following baud rates are supported on the R1 Port for BACnet MS/TP:

9600, 19200, 38400, 76800

3.2 R1 Port Small DIP Switches

Gently remove the FieldServer enclosure to access the small DIP switches for the R1 Port.

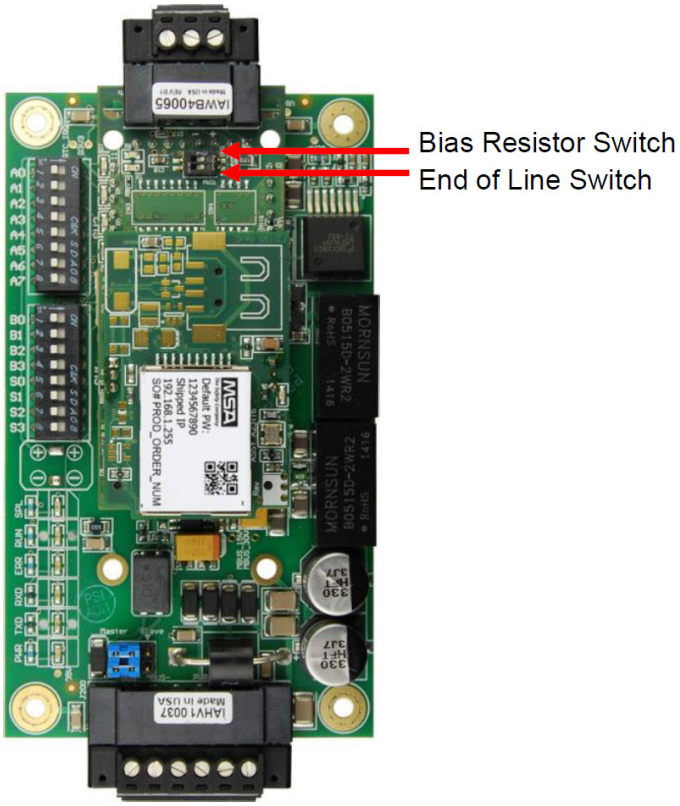

- If more than one RS-485 device is connected to the network, then the field bias resistor switch needs to be enabled to ensure proper communication. **See image abovefor the orientation of switch positions referenced below.**
  - The default factory setting is OFF (switch position = right side)
  - To enable biasing, turn the bias switch ON (switch position = left side)


NOTE: Biasing only needs to be enabled on one device. The EZ Gateway has 510-ohm resistors that are used to set the biasing.

- If the FieldServer is the last device on the trunk, then the end of line (EOL) termination switch needs to be enabled. **See image above for the orientation of switch positions referenced below.**
  - The default factory setting is OFF (switch position = right side)
  - To enable the EOL termination, turn the EOL switch ON (switch position = left side)


4 Operation

4.1 Power Up the Device

Apply power to the device. Ensure that the power supply used complies with the specifications provided. Ensure that the cable is grounded using the “Frame GND” terminal. The EZ Gateway is factory set for 12-30VDC or 12-24VAC.

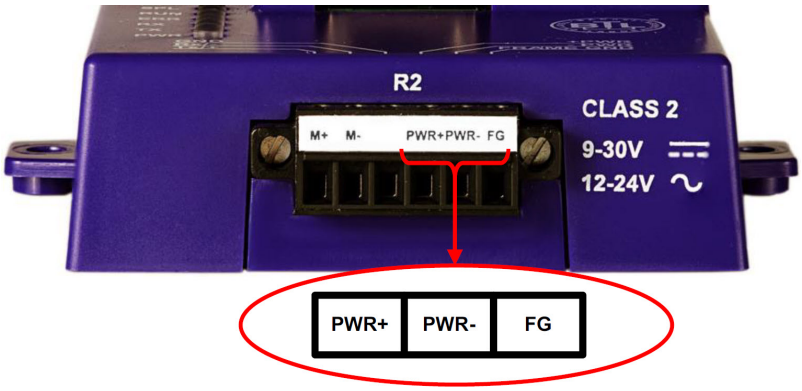

4.2 Connect the PC to the EZ Gateway Over the Ethernet Port

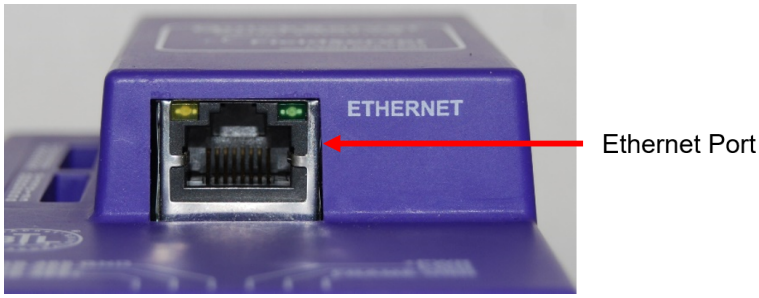

- Connect an Ethernet cable between the PC and EZ Gateway or connect the EZ Gateway and the PC to the switch using a straight Cat-5 cable.
- The Default IP Address of the EZ Gateway is **192.168.2.101**, Subnet Mask is **255.255.255.0**.

4.3 Access EZ Gateway Using a Web Browser

- Open a web browser and connect to the EZ Gateway’s default IP Address. The default IP Address of the EZ Gateway is **192.168.2.101**, Subnet Mask is **255.255.255.0**.
- If the PC and the EZ Gateway are on different IP networks, assign a static IP Address to the PC on the 192.168.2.X network.

NOTE: Check Section 8.5 Internet Browser Software Support for supported browsers.

5 Setup Web Server Security


5.1 Login to the FieldServer

The first time the FieldServer GUI is opened in a browser, the IP Address for the gateway will appear as untrusted. This will cause the following pop-up windows to appear.


- When the Web Server Security Unconfigured window appears, read the text and choose whether to move forward with HTTPS or HTTP.



- When the warning that “Your connection is not private” appears, click the advanced button on the bottom left corner of the screen.

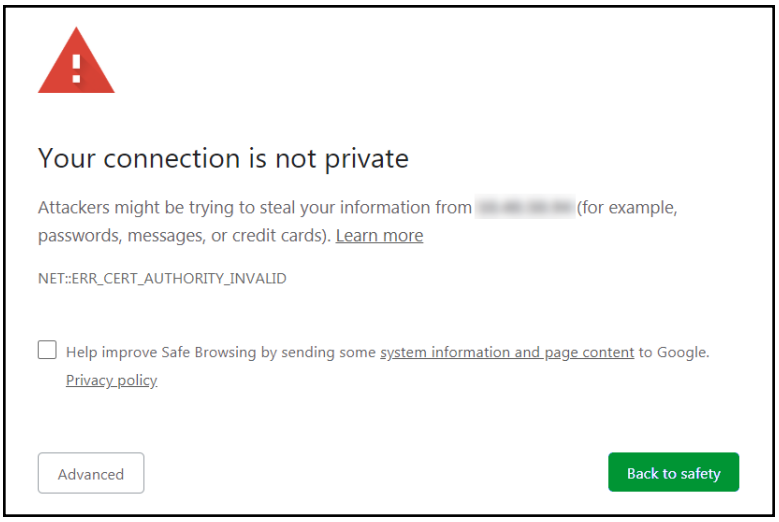


- Additional text will expand below the warning, click the underlined text to go to the IP Address. In the example below this text is "Proceed to <FieldServer IP> (unsafe)".

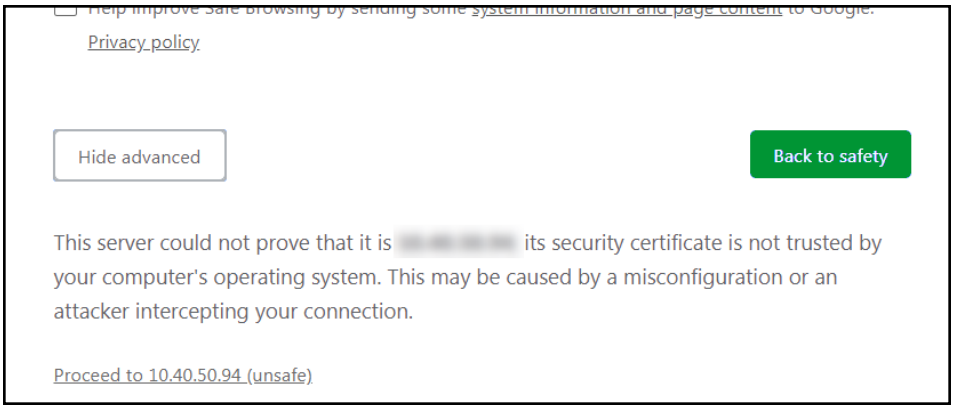

- When the login screen appears, put in the Username (default is "admin") and the Password (found on the label of the FieldServer).

NOTE: There is also a QR code in the top right corner of the FieldServer label that shows the default unique password when scanned.

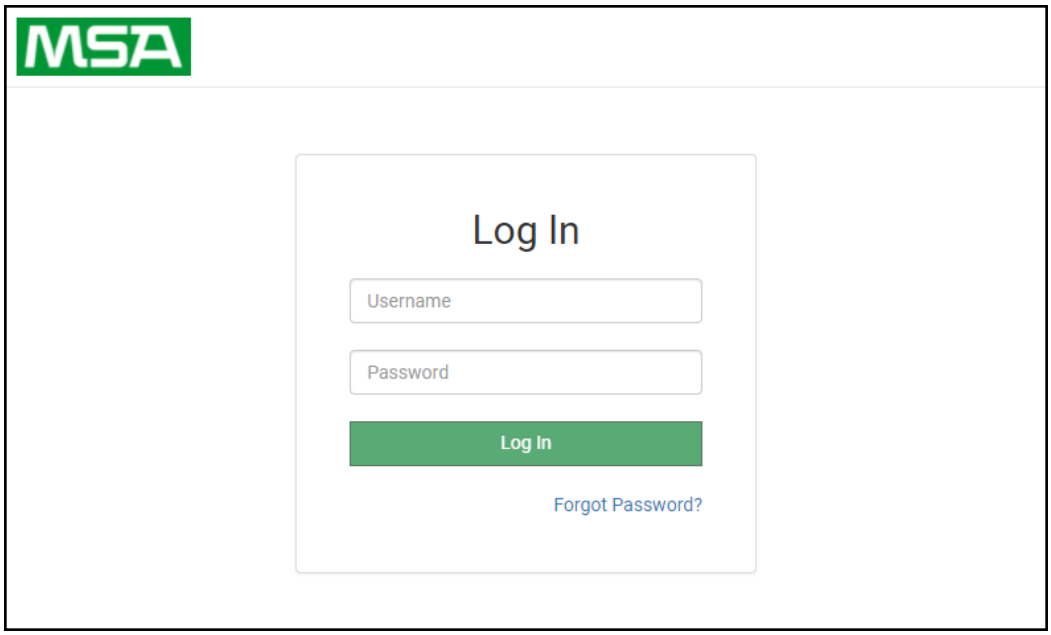


NOTE: A user has 5 attempts to login then there will be a 10-minute lockout. There is no timeout on the FieldServer to enter a password.

NOTE: To create individual user logins, go to Section 9.2 Change User Management Settings.

5.2 Select the Security Mode

On the first login to the FieldServer, the following screen will appear that allows the user to select which mode the FieldServer should use.

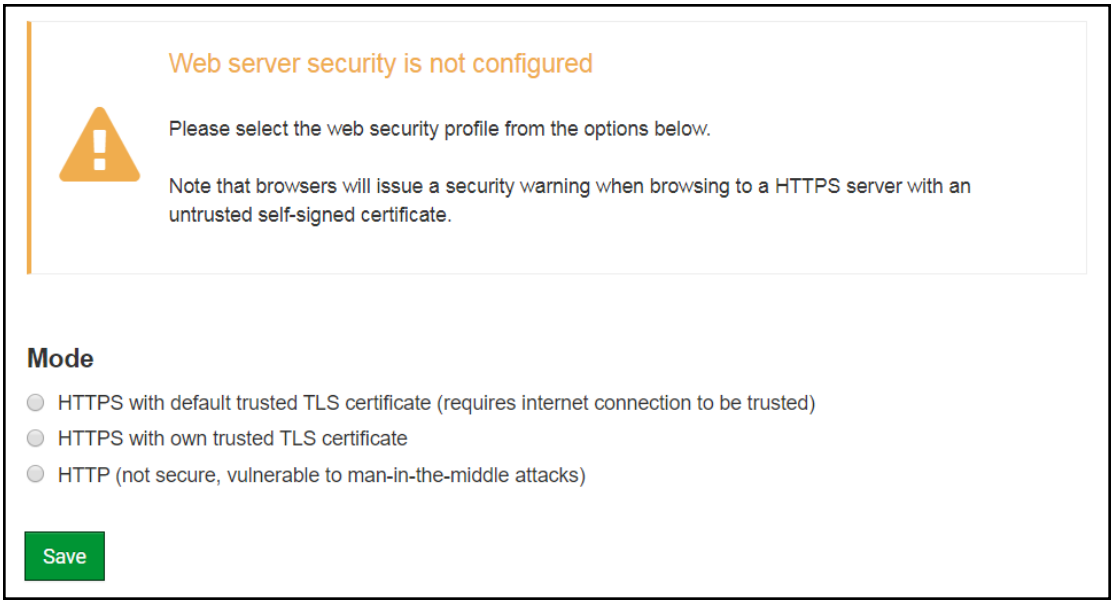

NOTE: Cookies are used for authentication.


NOTE: To change the web server security mode after initial setup, go to Section 9.1 Change Web Server Security Settings After Initial Setup.

The sections that follow include instructions for assigning the different security modes.

5.2.1 HTTPS with Own Trusted TLS Certificate

This is the recommended selection and the most secure. **Please contact your IT department to find out if you can obtain a TLS certificate from your company before proceeding with the Own Trusted TLS Certificate option.**

- Once this option is selected, the Certificate, Private Key and Private Key Passphrase fields will appear under the mode selection.

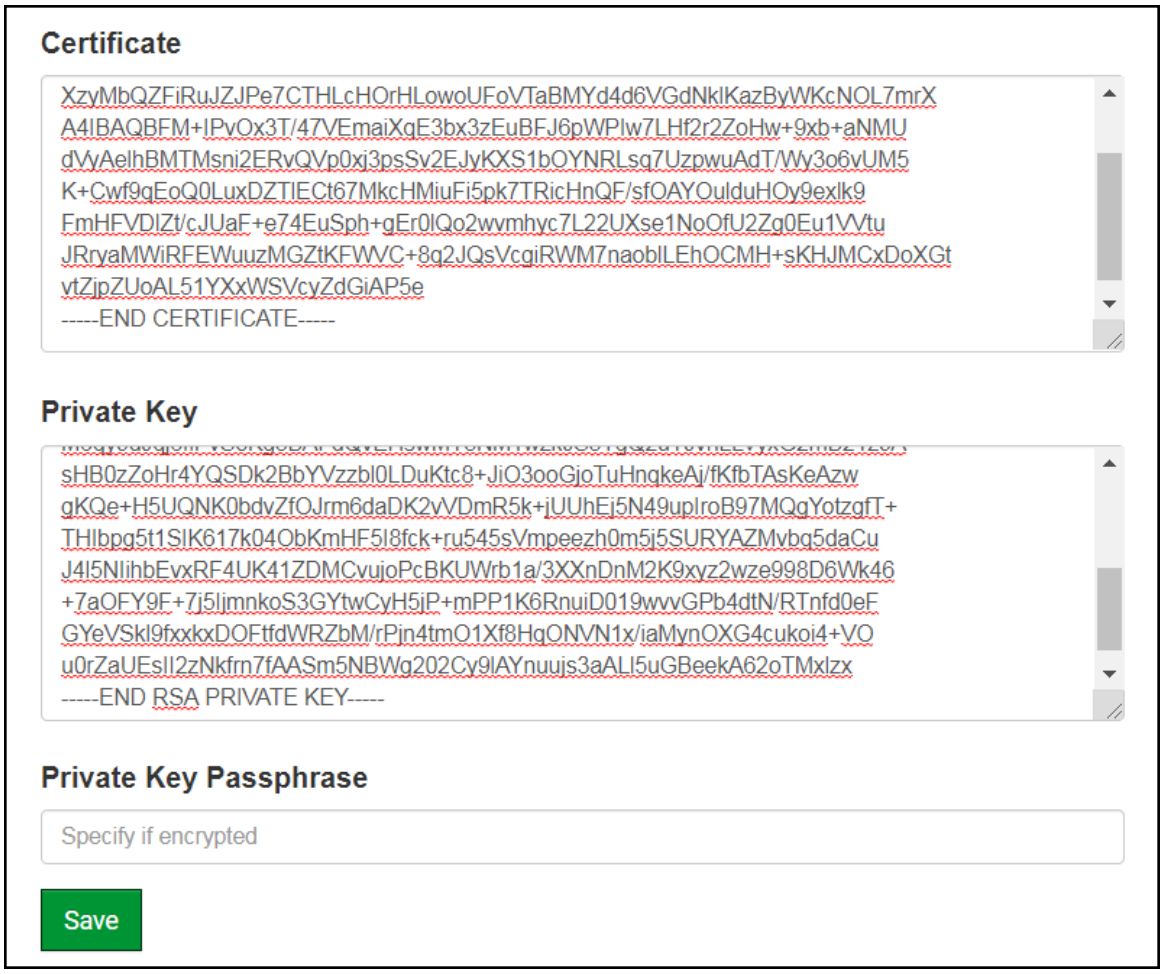


- Copy and paste the Certificate and Private Key text into their respective fields. If the Private Key is encrypted type in the associated Passphrase.
- Click Save.
- A “Redirecting” message will appear. After a short time, the FieldServer GUI will open.


5.2.2 HTTPS with Default Untrusted Self-Signed TLS Certificate or HTTP with Built-in Payload Encryption

- Select one of these options and click the Save button.
- A “Redirecting” message will appear. After a short time, the FieldServer GUI will open.

6 Configuring the EZ Gateway


Once the web server setup is complete, the EZ Gateway landing page will appear.

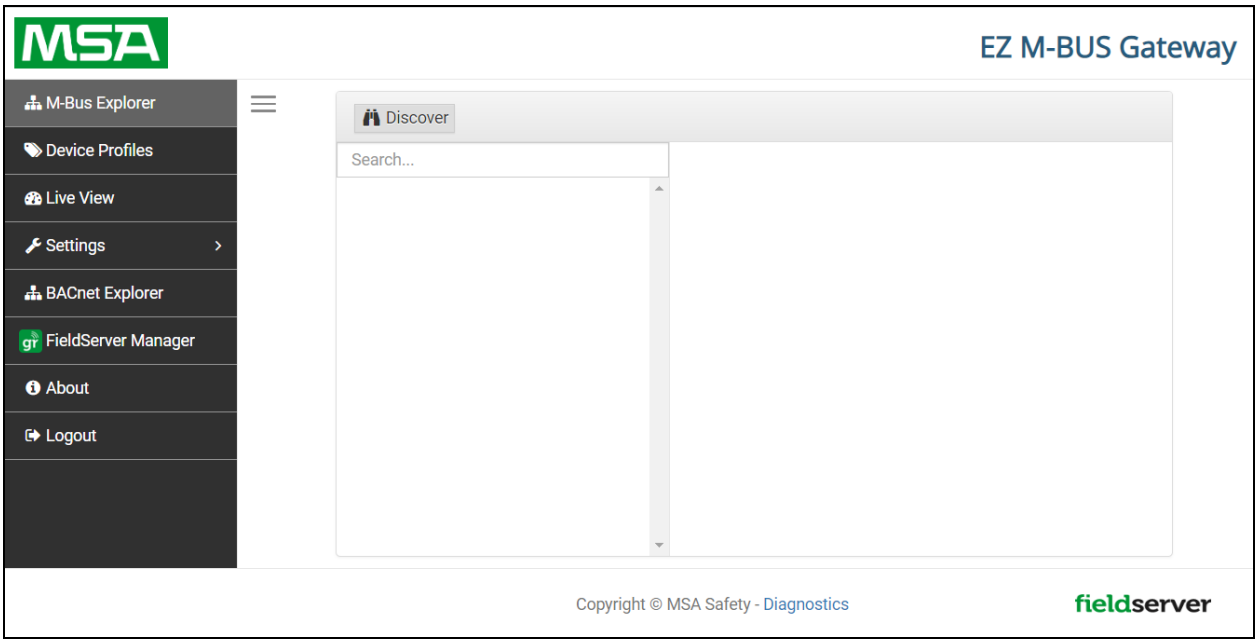

NOTE: The FieldServer Manager tab 

(see screenshot above) allows users to connect to the Grid, MSA Safety's device cloud solution for IIoT. The FieldServer Manager enables secure remote connection to field devices through a FieldServer and its local applications for configuration, management, maintenance. For more information about the FieldServer Manager, refer to the MSA Grid - FieldServer Manager Start-up Guide.

Click on the Settings tab (wrench icon) to show all three settings pages: M-Bus, BMS and Network Settings.

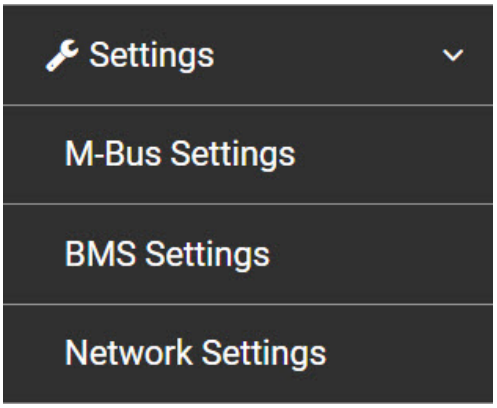


The table below describes how the buttons at the bottom of each page function.

Button	Definition
Save	Click to save settings. Saving will require the device to be restarted.
Reset	Click to clear the current settings before saving; if settings have been saved the Reset button is unavailable.

The following sections explain the setting parameters by page for the EZ Gateway.

6.1 M-Bus Settings

Enter the desired Baud Rate for the M-Bus port on the EZ Gateway.
The following baud rates are supported for M-Bus: 2400, 4800, 9600, 19200, 38400

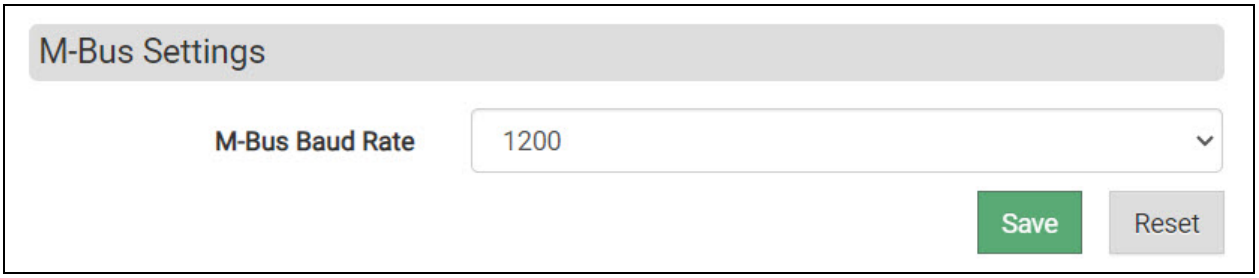



NOTE: This Setting is also known as the global baud rate. The EZ Gateway supports communication between devices with different baud rates at the same time. You can specify a profile baud rate when creating or editing a profile.

6.2 BMS Settings

Select appropriate protocol and enter the fields for the protocol settings described below as needed.


6.2.1 BACnet/IP and BACnet MS/TP

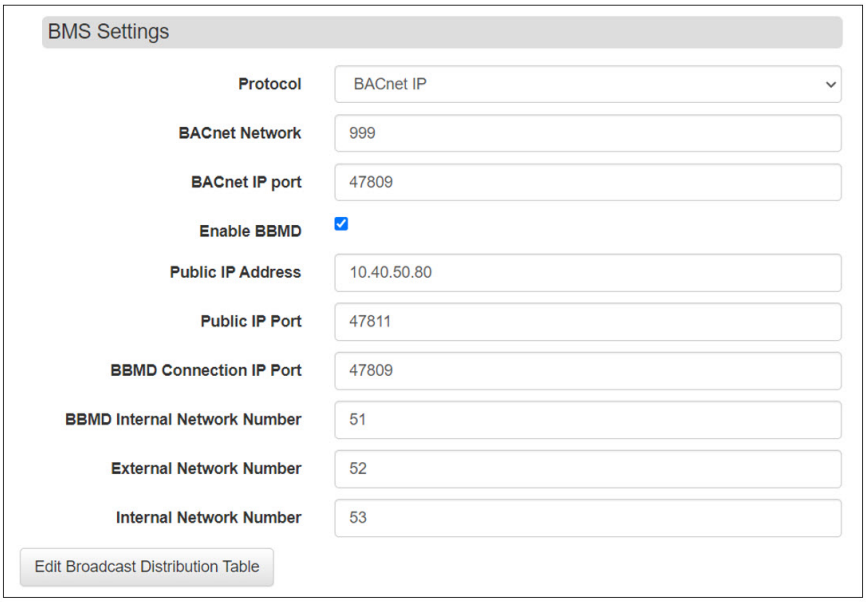

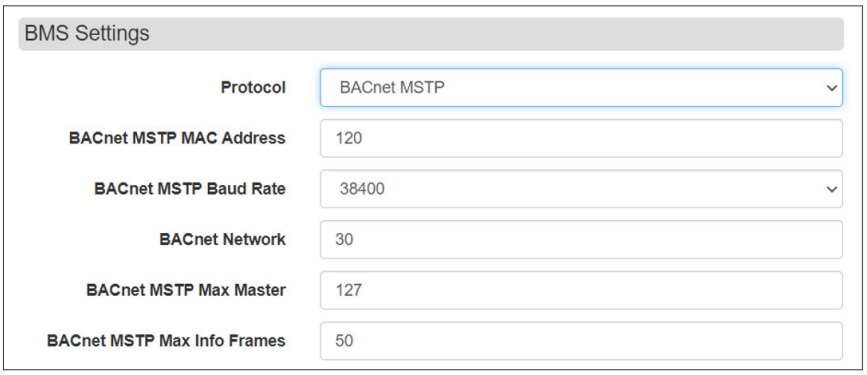


Parameter	Definition
All Connections	
BACnet Network	The BACnet network number for the connection. Legal values are 1-65534. Each network number must be unique across the entire BACnet internetwork.
BACnet/IP Settings	
IP Port	The BACnet/IP default is 47808 (0xBAC0), but other port numbers can be specified.
BACnet MS/TP Settings	
MAC Address	Legal values are 0-127, must be unique on the physical network.
Max Master	The highest MAC address to scan for other MS/TP master devices. The default of 127 is guaranteed to discover all other MS/TP master devices on the network.
Max Info Frames	The number of transactions the BACnet Explorer may initiate while it has the MS/TP token. Default is 50.
Baud Rate	The serial baud rate used on the network.


Enabling BBMD and Editing the Broadcast Distribution Table

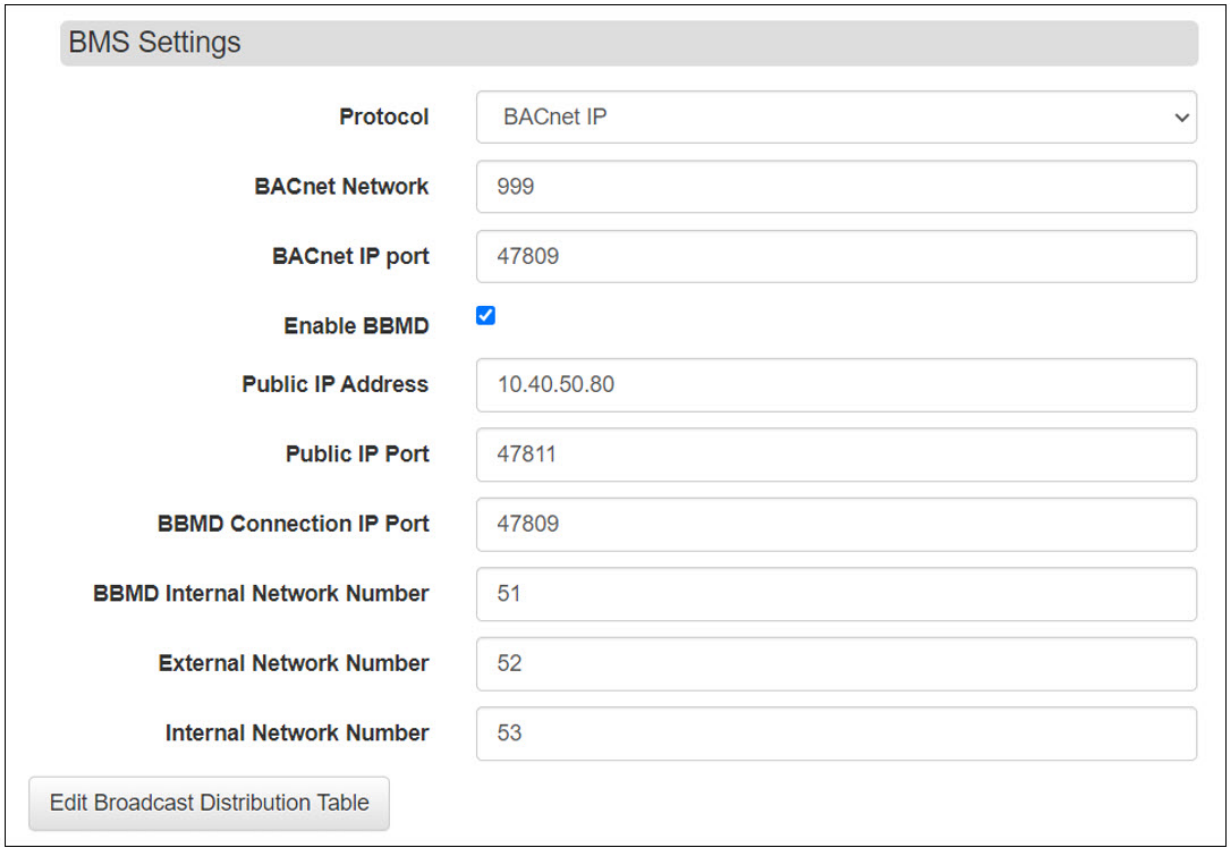


Parameter	Definition
BACnet/IP BBMD Settings	
Enable BBMD	Select this checkbox to enable the Router to act as a BBMD.
Public IP Address	If the BBMD is being accessed across a NAT Router, then these values must be configured with the public IP address and Port by which the BBMD can be reached from across the NAT Router. The Public IP Address and Port would also be used in the Broadcast Distribution Table (BDT) of remote BBMD's that need to reach this BBMD across the NAT Router (see Figure 20). If no NAT Router is being used, these fields can be left blank.
Public IP Port	This MUST be different to the IP Port used on the BACnet/IP Primary connection. Default is 47809 (0xBAC1).

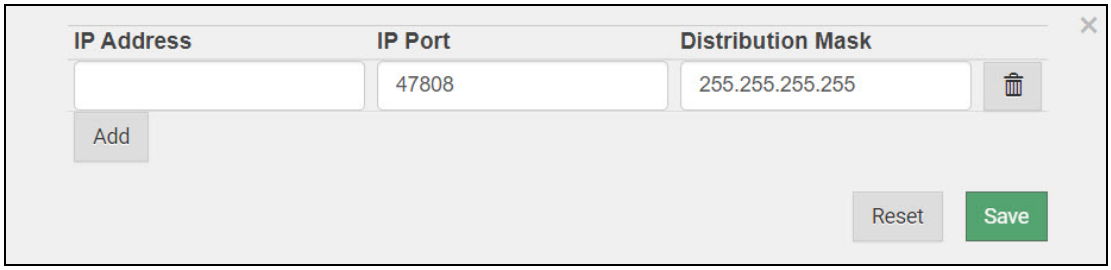

6.2.2 Modbus TCP/IP and Mobus RTU

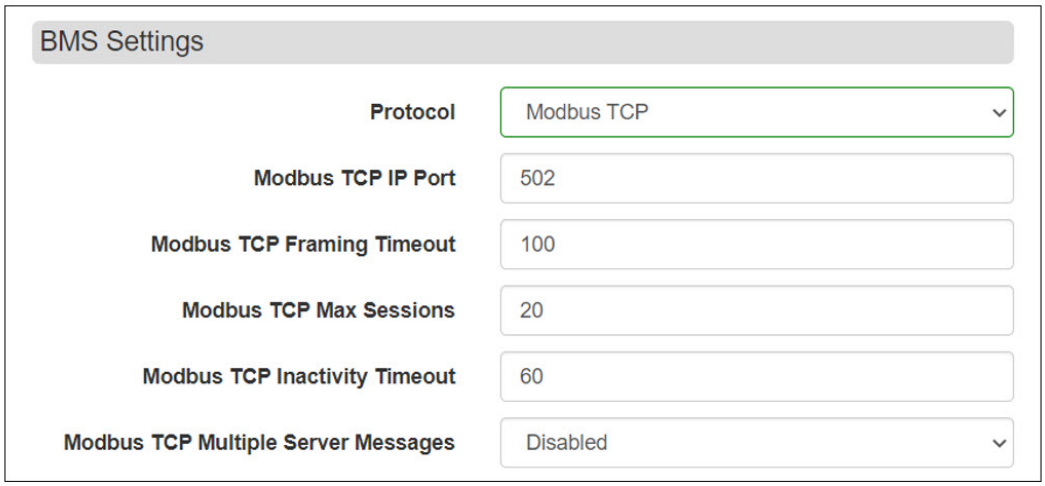


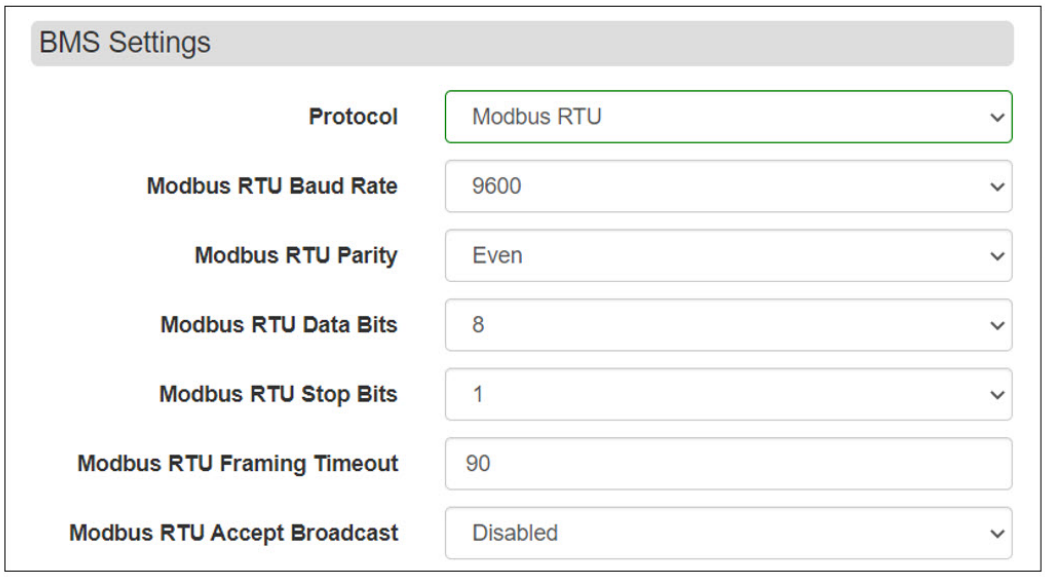

Parameter	Definition
All Connections	
Framing Timeout	Sets time EZ Gateway will wait for a message frame to complete on the network. This is useful on busy Modbus networks where unknown messages for other devices may cause longer timeouts. Legal values are 0 – 100 milliseconds (0 means disabled and 100 is default).
Accept Broadcast	Select whether server will accept broadcast messages.
Modbus TCP/IP Settings	
IP Port	The default is 502, but other port numbers can be specified.
Max Sessions	The maximum sessions that will be accepted by the server side.
Inactivity Timeout	The FieldServer will close the connection opened by the client if there is no activity for this time period.
Multiple Server Messages	Enable or disable the ability to parse multiple messages in a stream.
Modbus RTU Settings	
Parity, Data Bits, Stop Bits, and Baud Rate	Specify desired values.

6.3 Network Settings


The Network settings for the EZ Gateway are used by BACnet/IP and Modbus TCP/IP. The IP settings can be edited in the Network Settings section as shown.

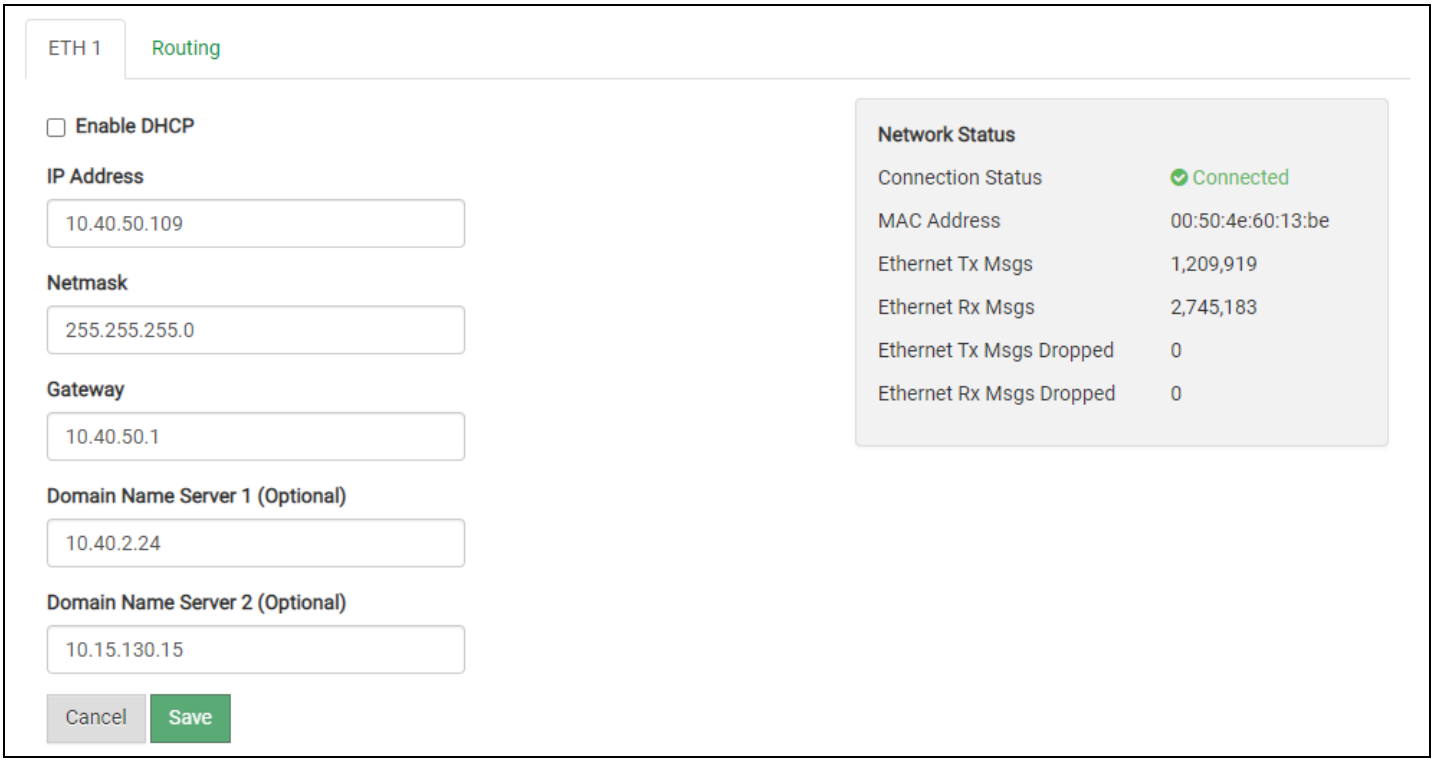


7 Using the EZ Gateway

7.1 Find Devices Using M-Bus Explorer Page

- Click on the M-Bus Explorer tab on the left side of the screen to go to the M-Bus Explorer page.

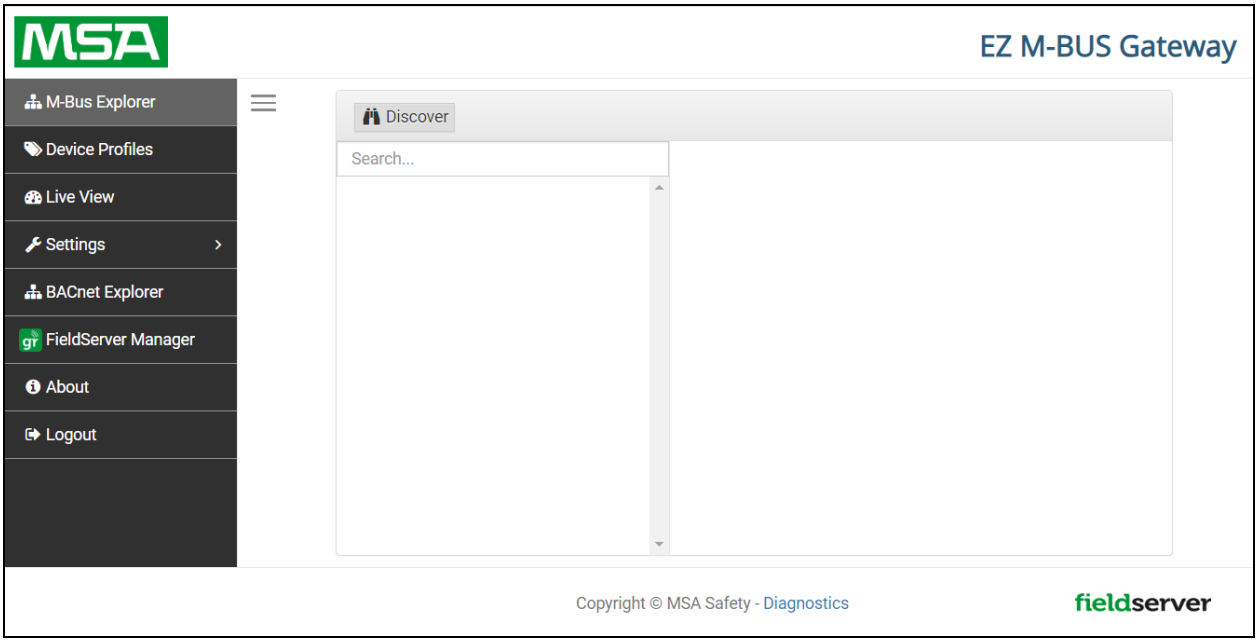

- To find M-Bus devices connected to the same subnet as the EZ Gateway, click the Discover button (binoculars icon).
- This will open the Device Discovery window, select Secondary Address or Test Address, then fill in the desired device ID range/baud rate(s) and click Discover to start the search.

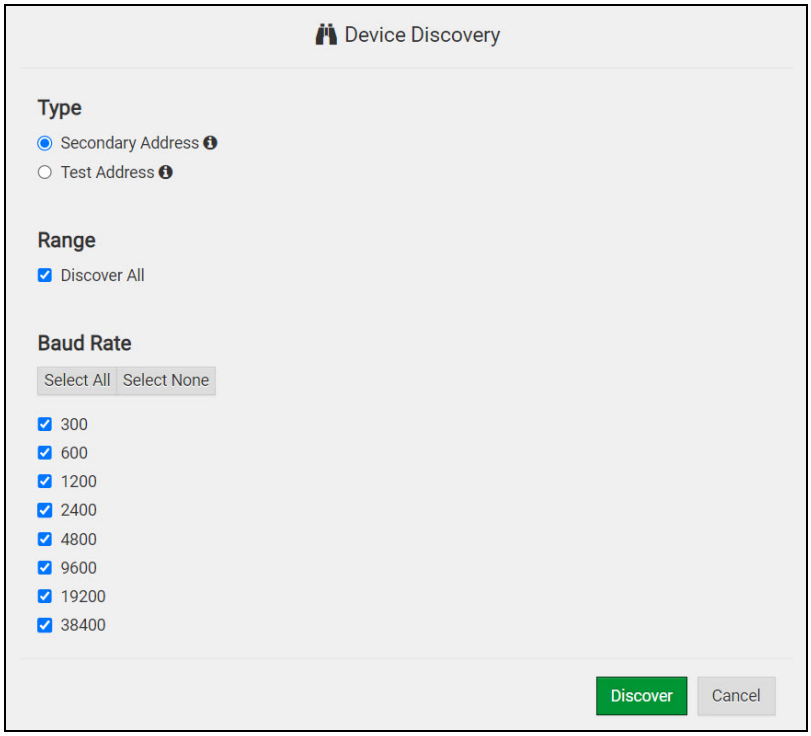

Discovery Types

There are two discovery types that are useful in different situations. See details below.

Secondary Address – This discovery type should be used when there are multiple devices connected to the bus to do a wildcard search across the full address space. However, only some M-Bus Slave devices support secondary address discovery.

Test Address – This discovery type should be used when there is a single device connected the bus to do a fast discovery. This type is also useful when a Slave device doesn't support secondary address discovery and needs to be connected one at a time to read each device's info for profile creation/address information.

- Wait until the Device Discovery process is complete - a blue progress bar will show the discovery progress and is followed by a green bubble stating that the discovery is complete.
- Once the discovery is finished, new M-Bus devices connected to the same bus should appear on the M-Bus Explorer page.



NOTE: Should any devices not be listed using Secondary Address Discovery, it is recommended that the undiscovered devices are connected one at a time to the M-Bus network and be discovered using the Test Address method.

Device Status

There are four possible statuses for a device, which are shown in parenthesis next to the discovered device.


No Profile – The EZ Gateway does not have a profile for this device.

Not Loaded – The EZ Gateway has a saved profile for this device but the profile instance is not loaded.

Loaded – The EZ Gateway has a saved profile for this device and the profile instance is loaded.

Data Error – Not all data could be retrieved for the device.

- Click a device to see device details and data.

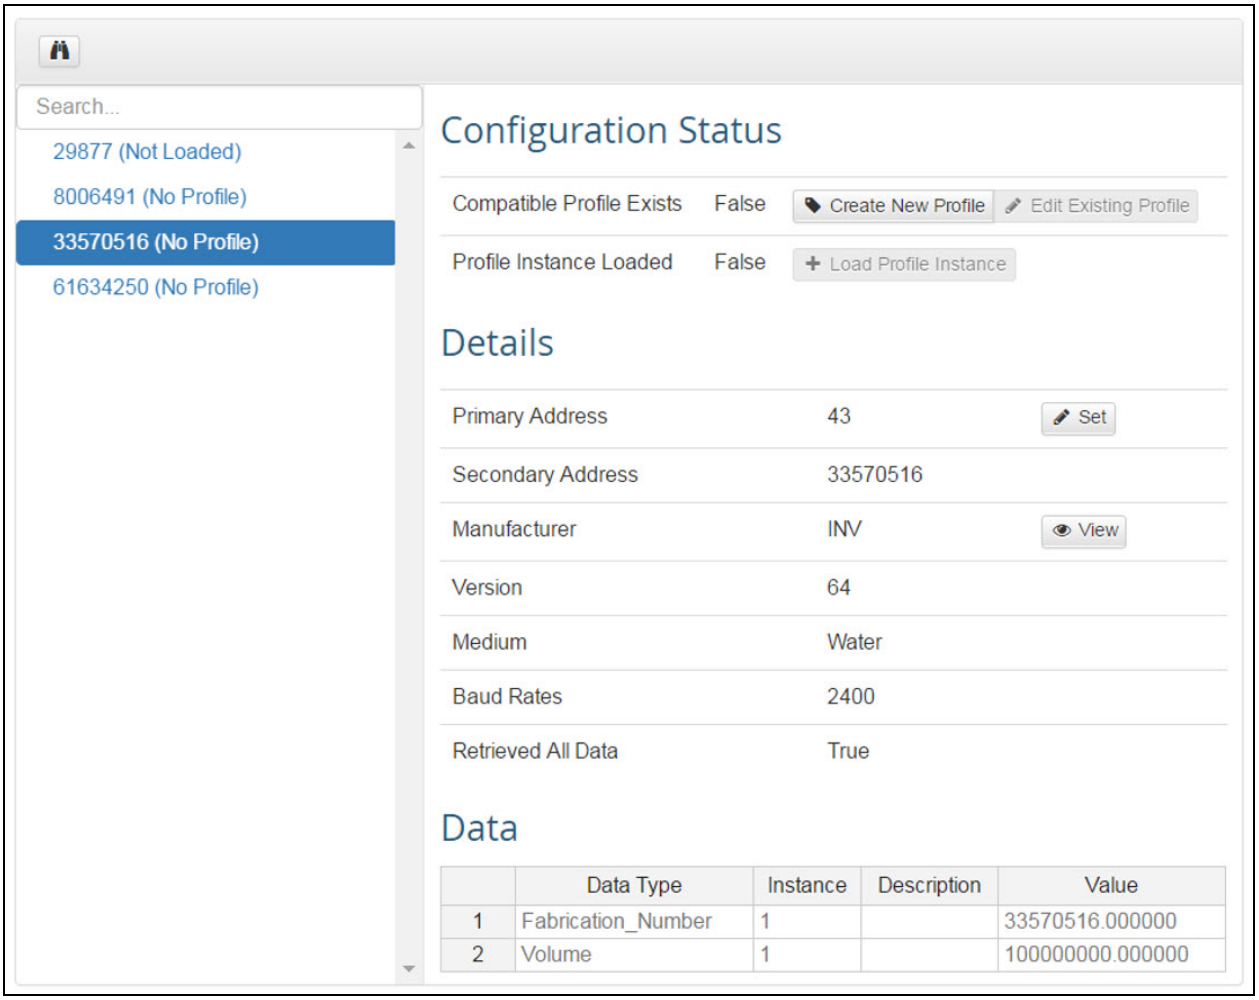


7.2 Create a Profile from a Discovered Device

- Click on the desired device to show Configuration Status, Details and Data.


Compatible Profile Exists – If “True” is displayed, a profile already exists for this M-Bus discovered device.

Profile Instance Loaded – If “True” is displayed, this profile has been created and the profile instance has been loaded.

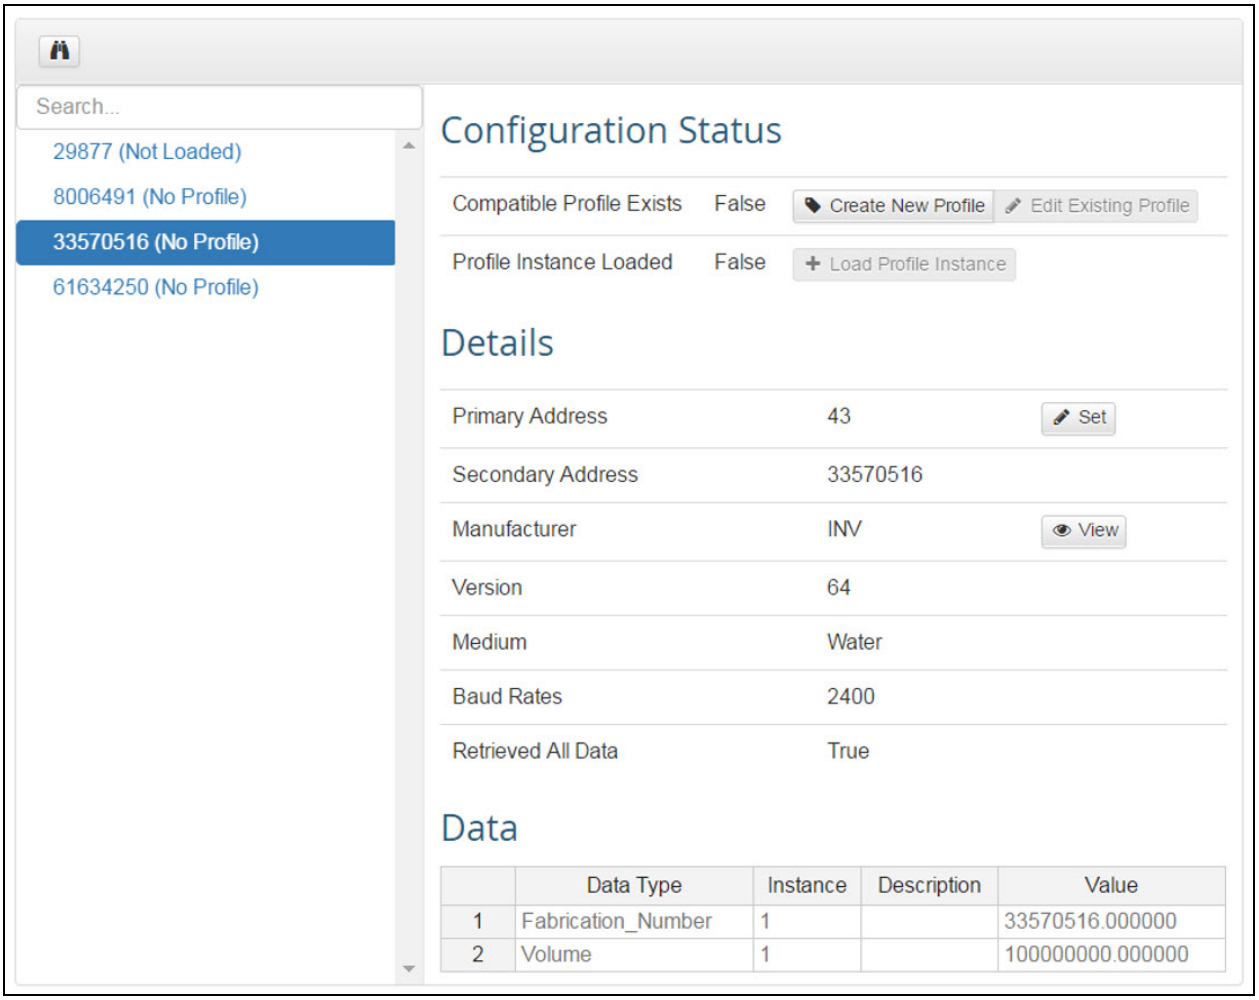


- Click on the Create New Profile button (under the Configuration Status section) to use this M-Bus data map as the template for a new profile.

- Define the Profile Settings as needed.

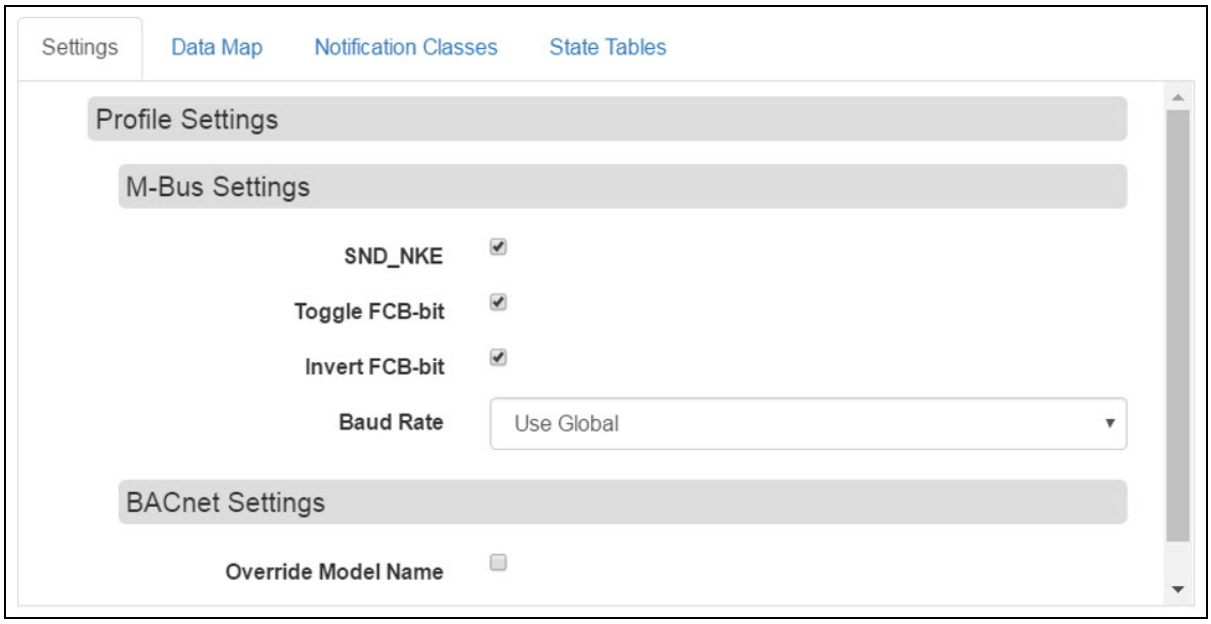

NOTE: A profile baud rate can be set to global or a specific buad rate. To set the global buad rate see Section 6.1 M-Bus Settings.

- Edit the Data Map as needed.

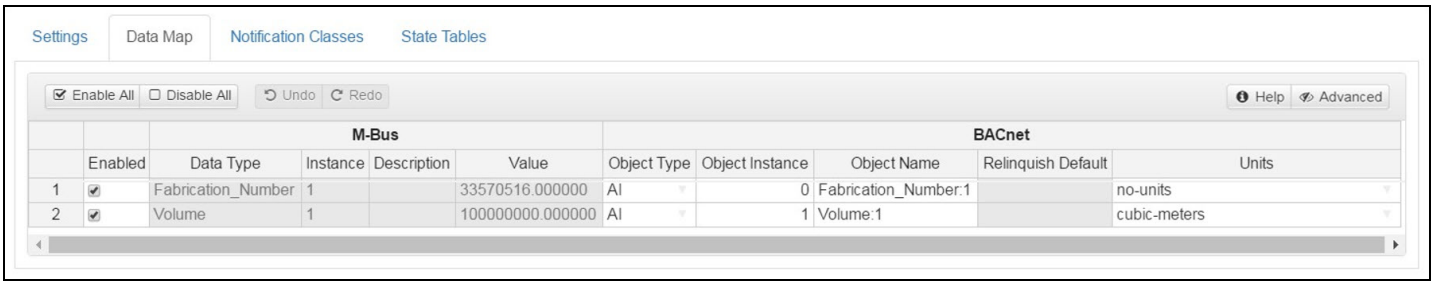


  - Click the Advanced button to see all possible mapping elements
  - Click the Help button to see detailed explanations of each element

- Add Notification Class(es) if needed.
  - Click the Add button and enter the number of Notification Classes to create
  - Fill in the fields as needed

NOTE: The desired notification class must be specified per point on the data map.

NOTE: The Save button will be disabled unless all red fields are filled in with valid values.

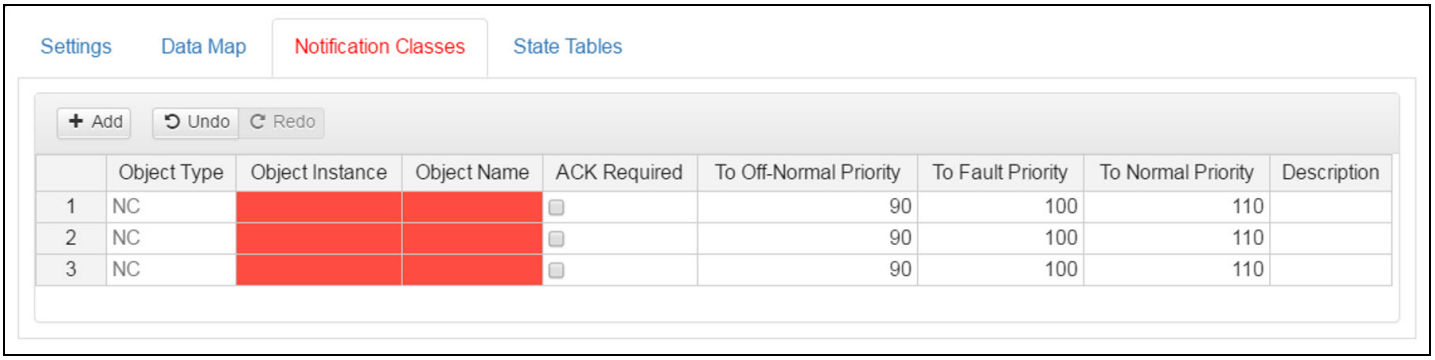

- Add State Table(s) if needed.
  - Click the Add button and enter the name of the State Table to create a new table
  - Click the table that was just created, then click the Add button in the table and enter the number of required entries (rows) for the table


NOTE: The desired notification class must be specified per point on the data map.




  - Fill in the desired state values and repeat this process if additional tables are required.

NOTE: The Save button will be disabled unless all red fields are filled in with valid values.

- Once all editing is complete, click the Save button to open the Save Profile window; name the profile and click Save again to complete profile creation.

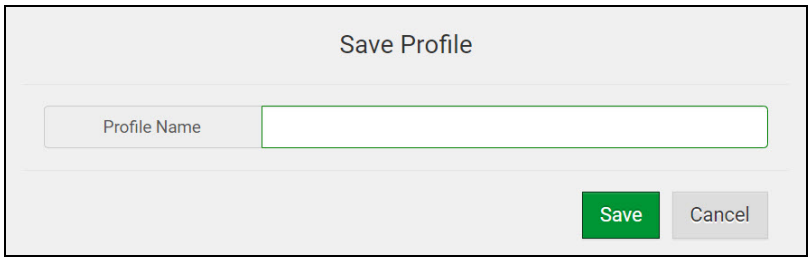


- After saving the profile the following messages will appear:

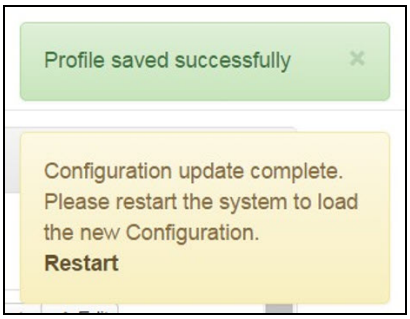

- Click the bolded “Restart” text on the bottom of the yellow message to restart the EZ Gateway.

7.3 Manage Profiles Using the Device Profiles Page

- Click on the Device Profiles tab on the left side of the screen to go to the device profiles page.

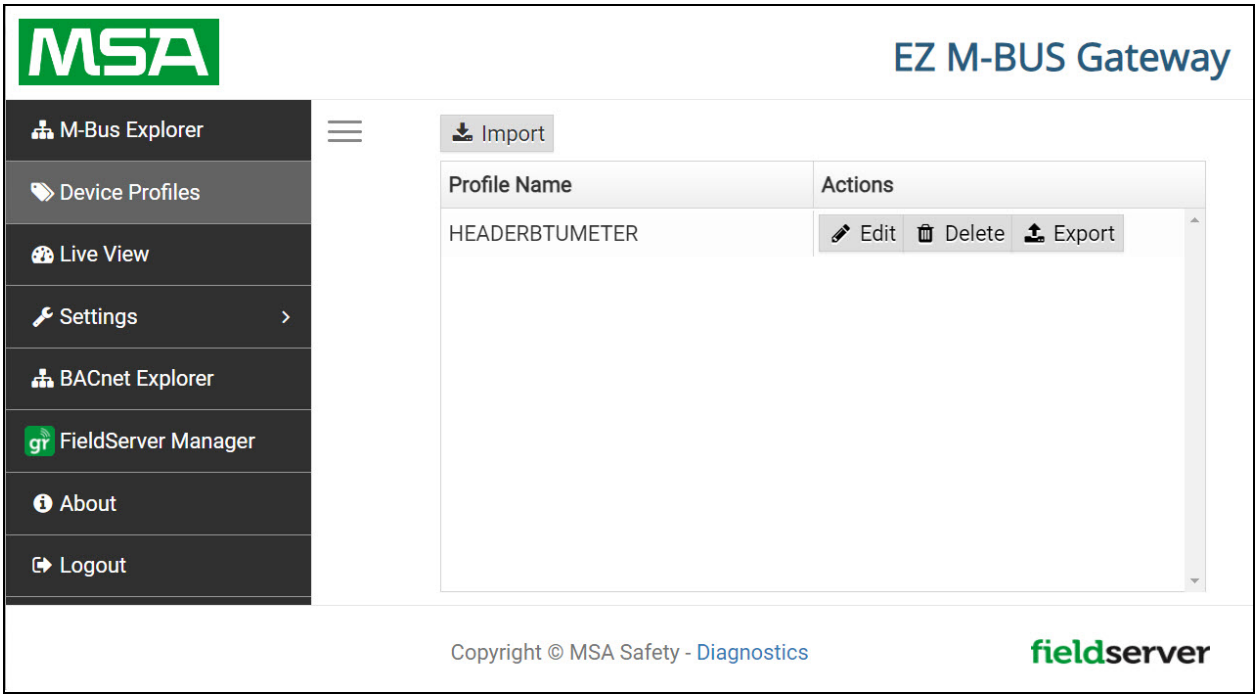


NOTE: If a profile has been saved from a discovered device using the M-Bus Explorer, the saved profiles will appear on this page.

- Profiles can be edited, deleted or exported as needed using the buttons under the Actions heading to the right of each profile name.
- Profiles can also be imported from the local PC using the Import button.

7.3.1 Import Button

- To import profiles from the local PC, click the Import button.
- Select the profile via the Import Profile window and click Import.

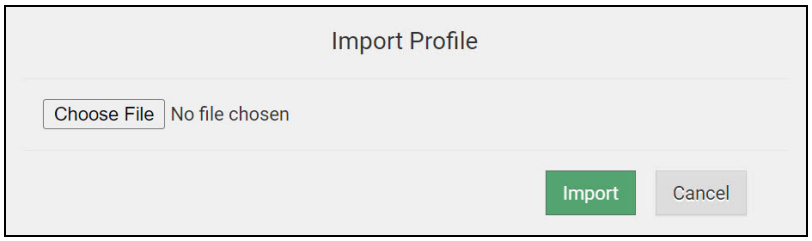


- A green bubble will appear that states the profile has been imported successfully.
- The new profile will now show on the Device Profiles page.


7.3.2 Edit Button

- Through the Edit button the Profile Settings, Data Map, Notification Classes and State Table can be redefined.


NOTE: See Section 7.2 Create a Profile from a Discovered Device for a walkthrough on editing profile information.

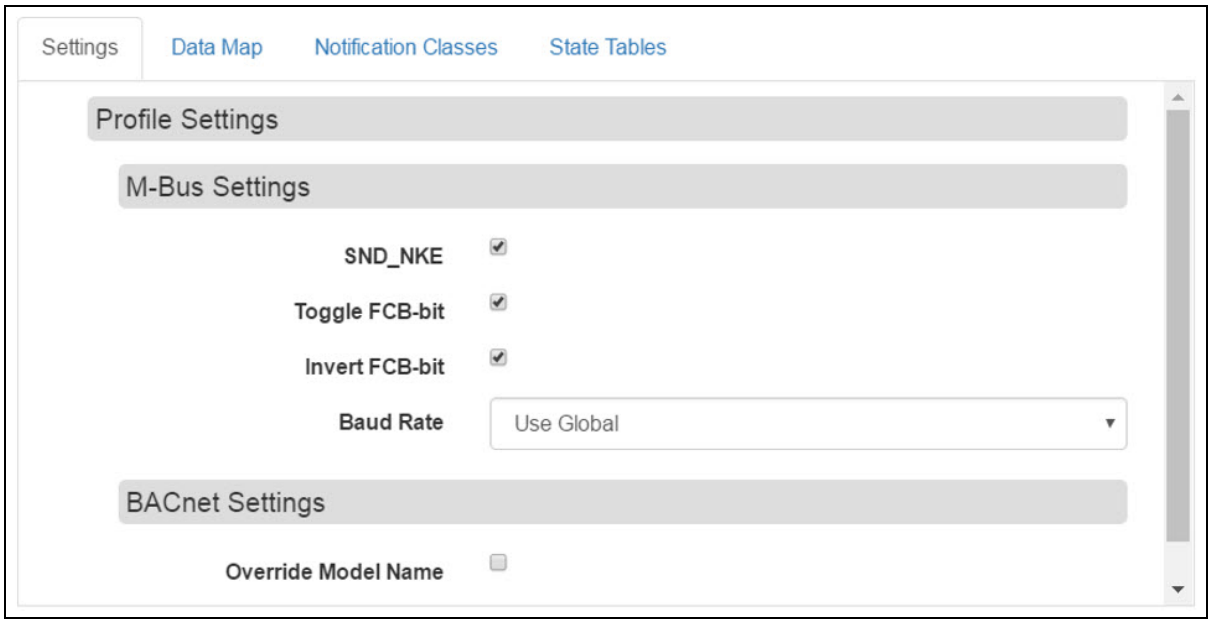

- Once all editing is complete, click the Save button to open the Save Profile window; name the profile and click Save again to complete profile creation.

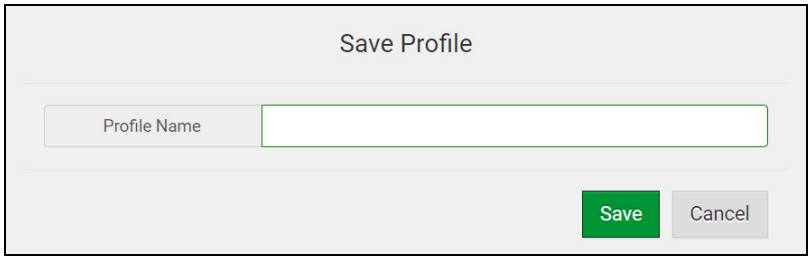


After saving the profile the following messages will appear:

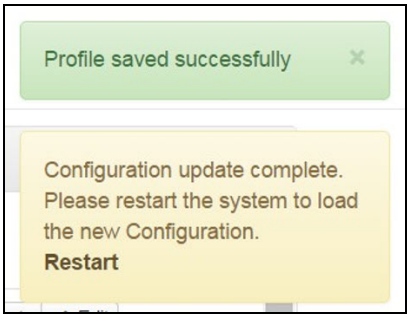

- Click the bolded “Restart” text on the bottom of the yellow message to restart the EZ Gateway.


7.3.3 Delete Button

- Click the Delete button to remove the profile in that row from the EZ Gateway.

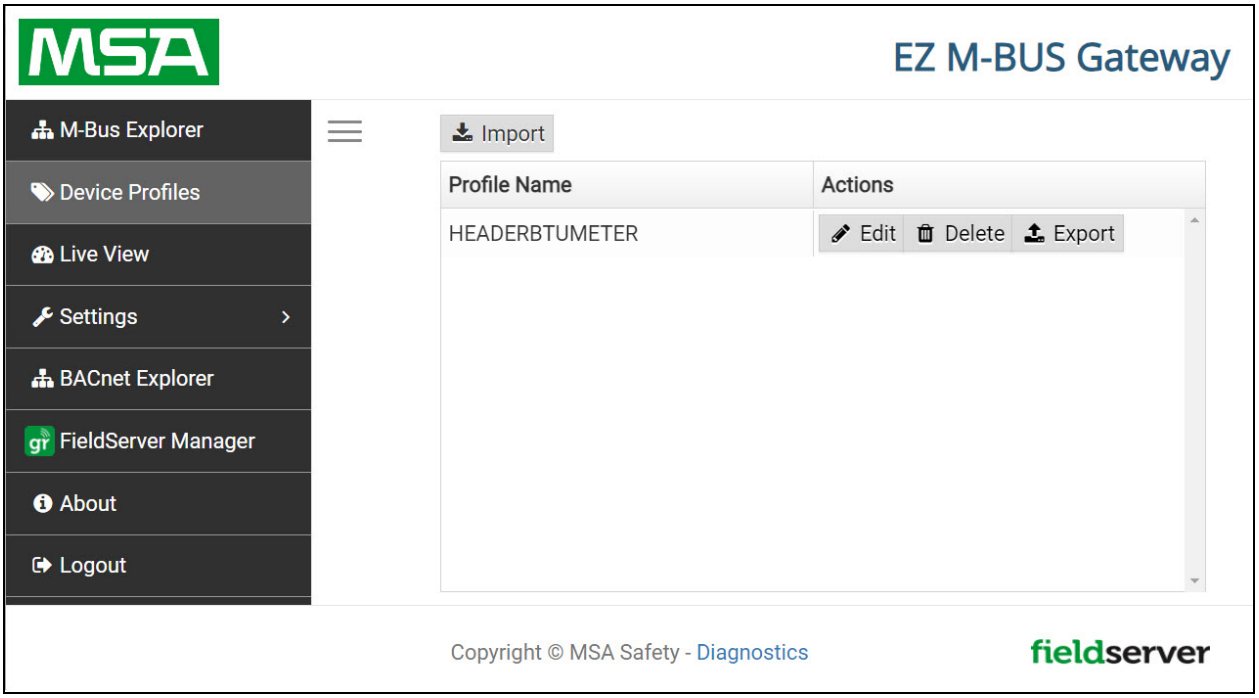

7.3.4 Export Button


- Click the Export button to create a copy of the profile in that row on the local computer's default download folder.

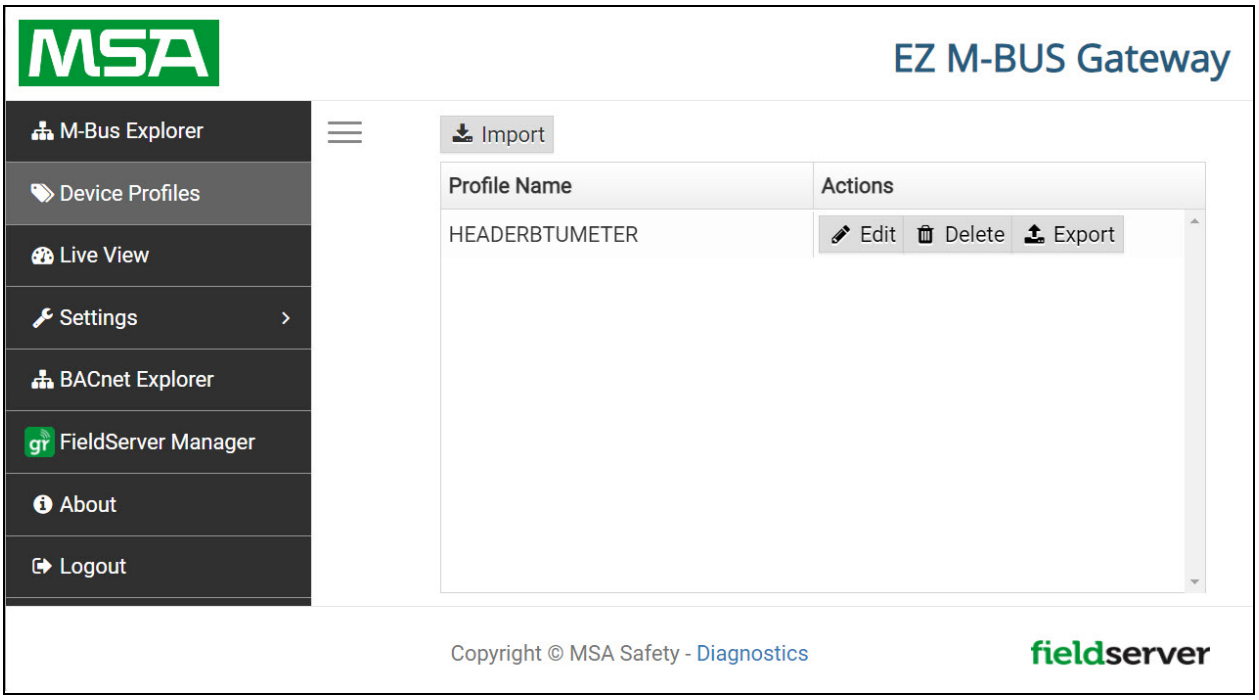


NOTE: The .profile file will instantly download to the default download folder.

7.4 Load a Profile Instance Using M-Bus Explorer


- Click the M-Bus Explorer tab.
- Click on a device to load that also has a profile saved on the EZ Gateway (the Compatible Profile Exists parameter is “True”).
- Click on the Load Profile Instance button.

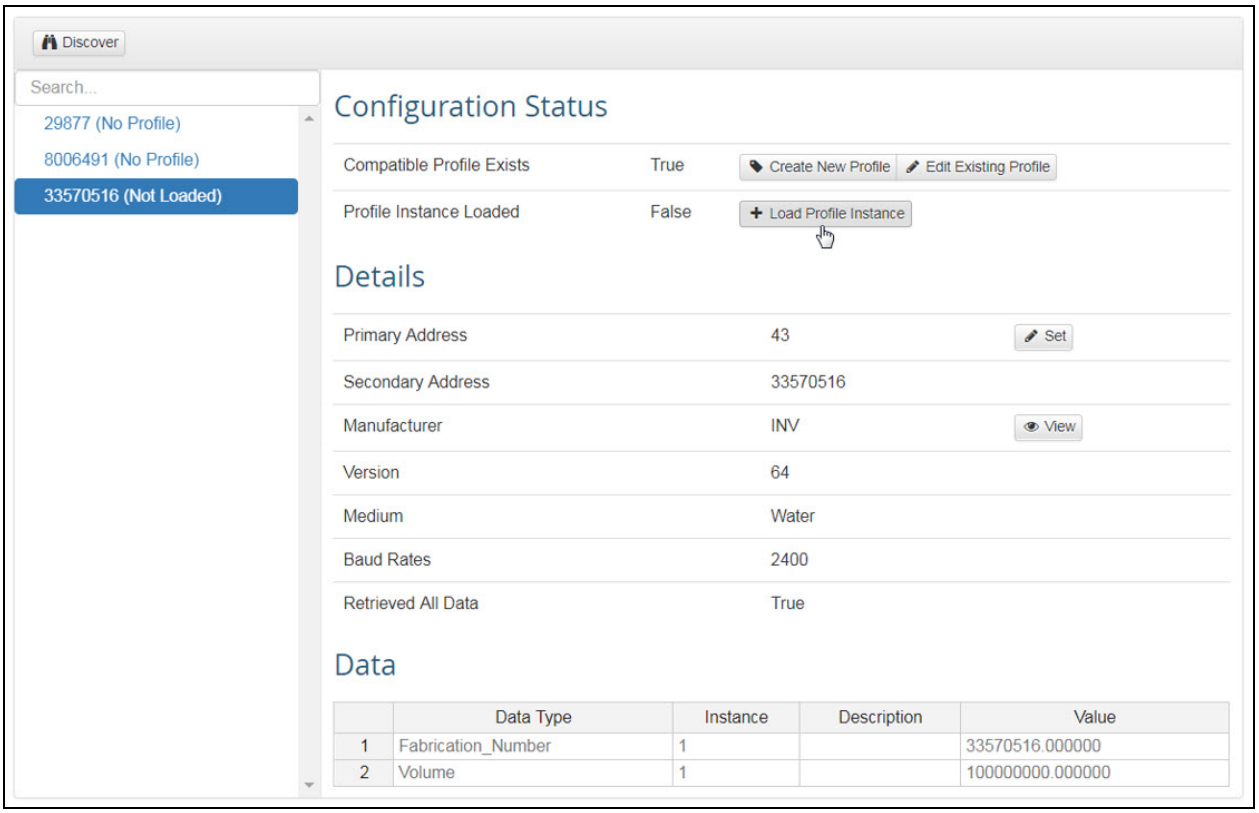

- Select the desired profile and click the Select button.

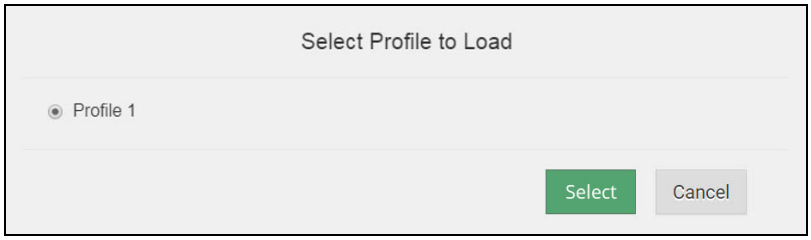


- The associated BACnet and M-Bus parameters will populate from the profile saved on the EZ Gateway.

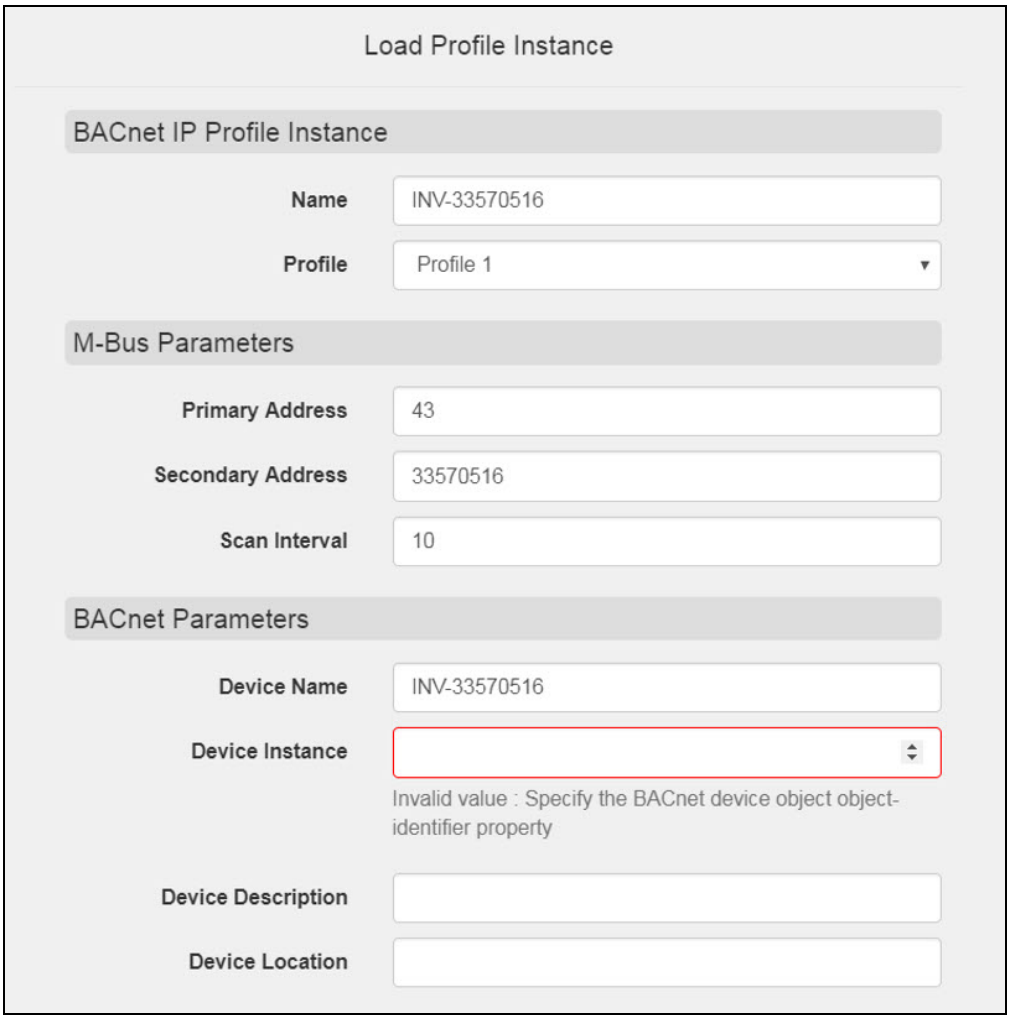

- Edit and enter additional parameter information as needed.
- Click Save and then click Restart when prompted to load the new settings.


7.5 View Live Data Using Live View

- Click on the Live View tab on the left side of the screen to go to the Live View page.
  - The Live View page will now show the created profile instance

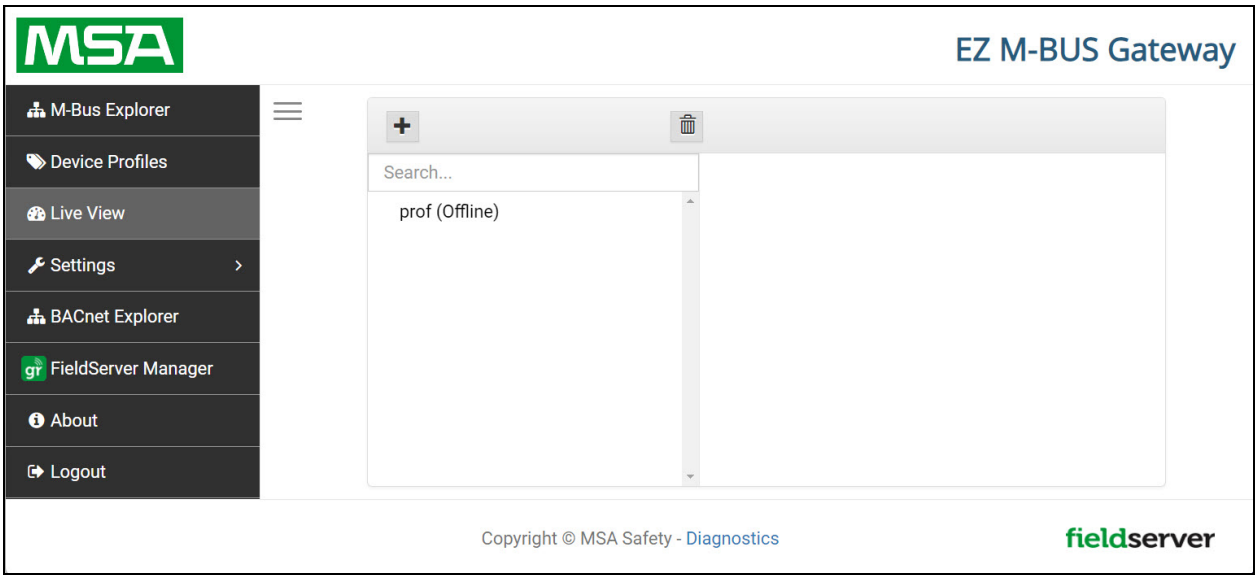


- Click the profile listing to view or edit the entry as needed.
  - The loaded profile will show:


Live Data – Status, Messages and Data

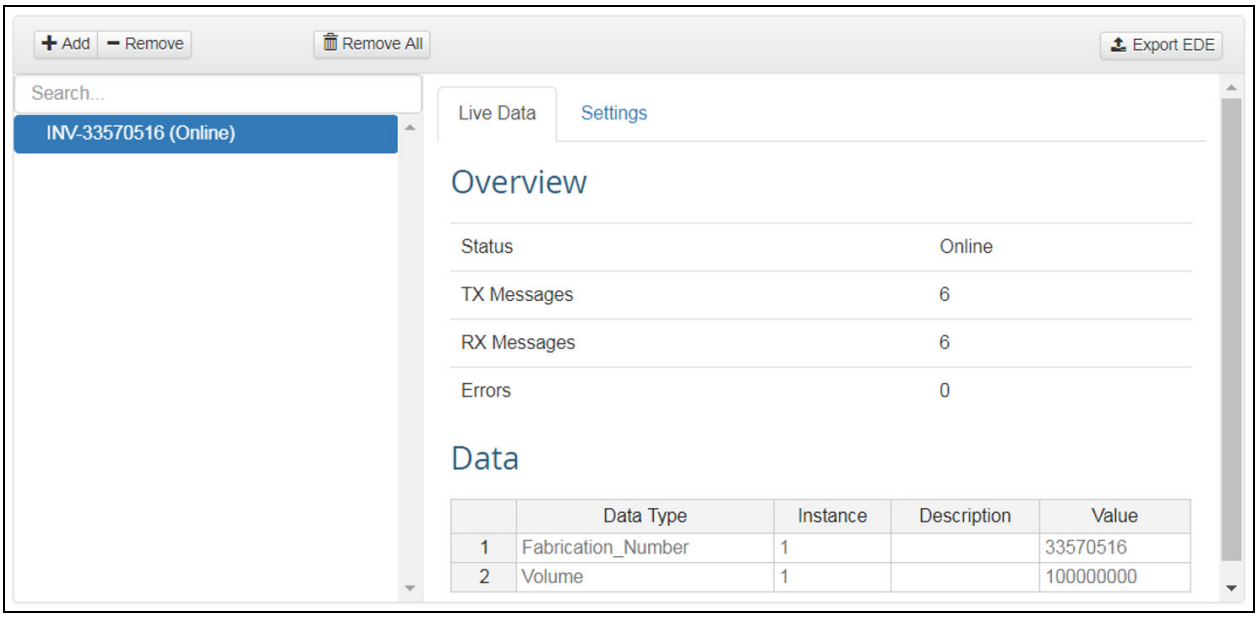

Settings – Profile Instance, M-Bus Parameters and BACnet Parameters

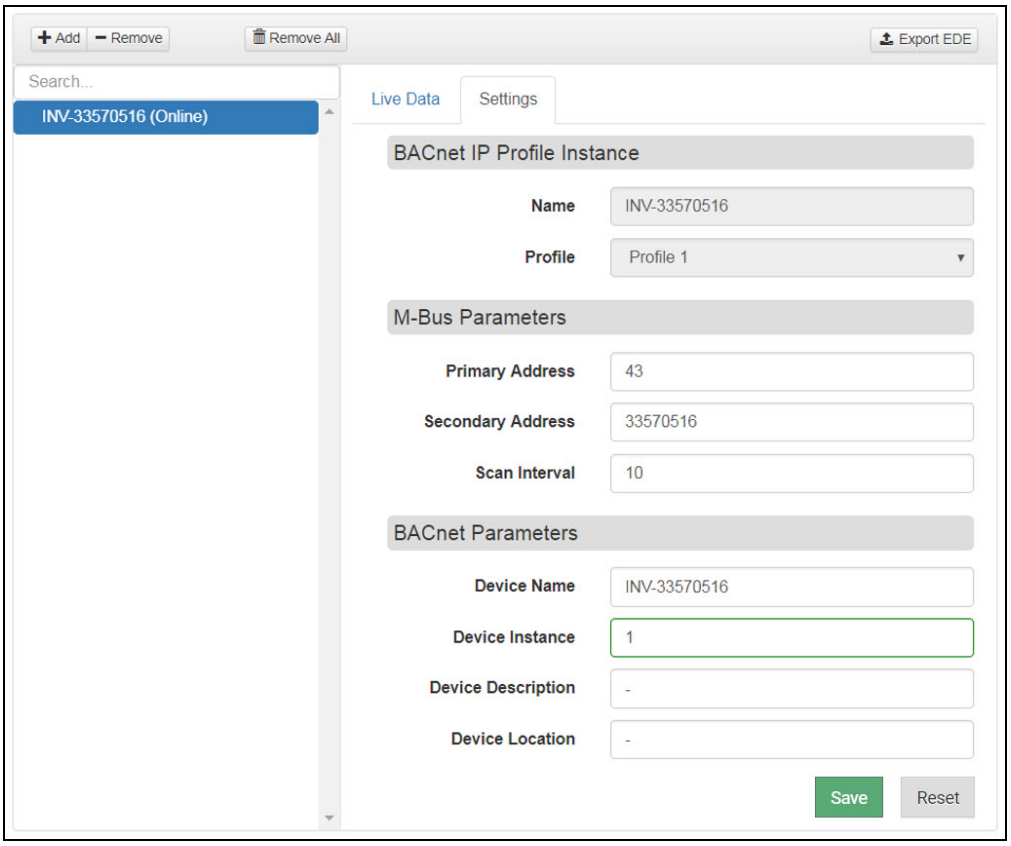


NOTE: To export the EDE file, click the Export EDE button and fill out the Export EDE window as needed.

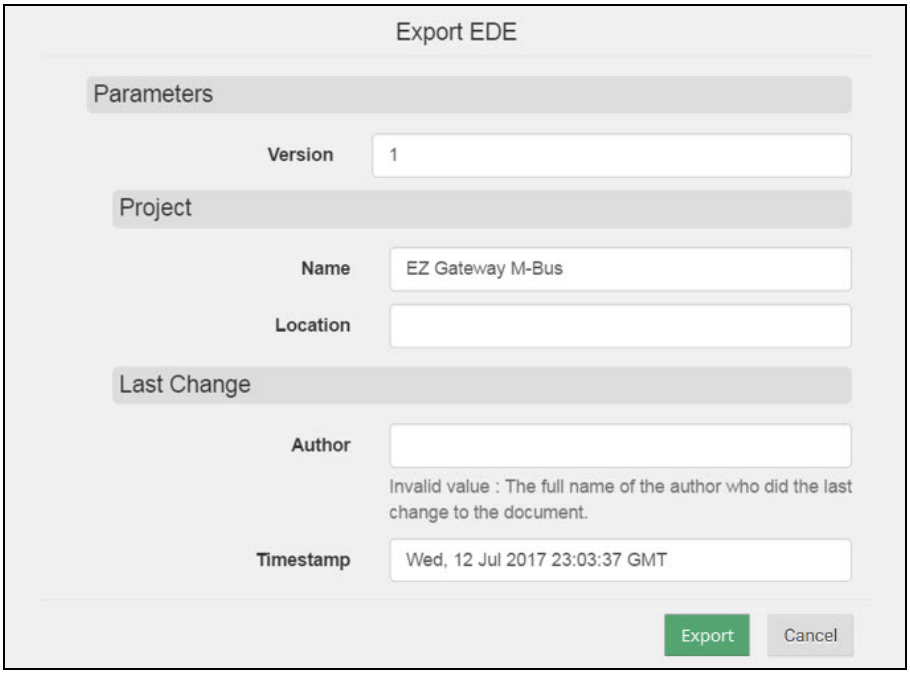

7.6 Diagnostics and Cloud Connection

- Connect the EZ Gateway to the third party device(s), and test the application.
- Click on the Diagnostic link (found along the bottom of the page) to open the FS-GUI.
- From the main menu of the FS-GUI click on View in the navigation tree, then Connections to see the number of messages on each protocol.

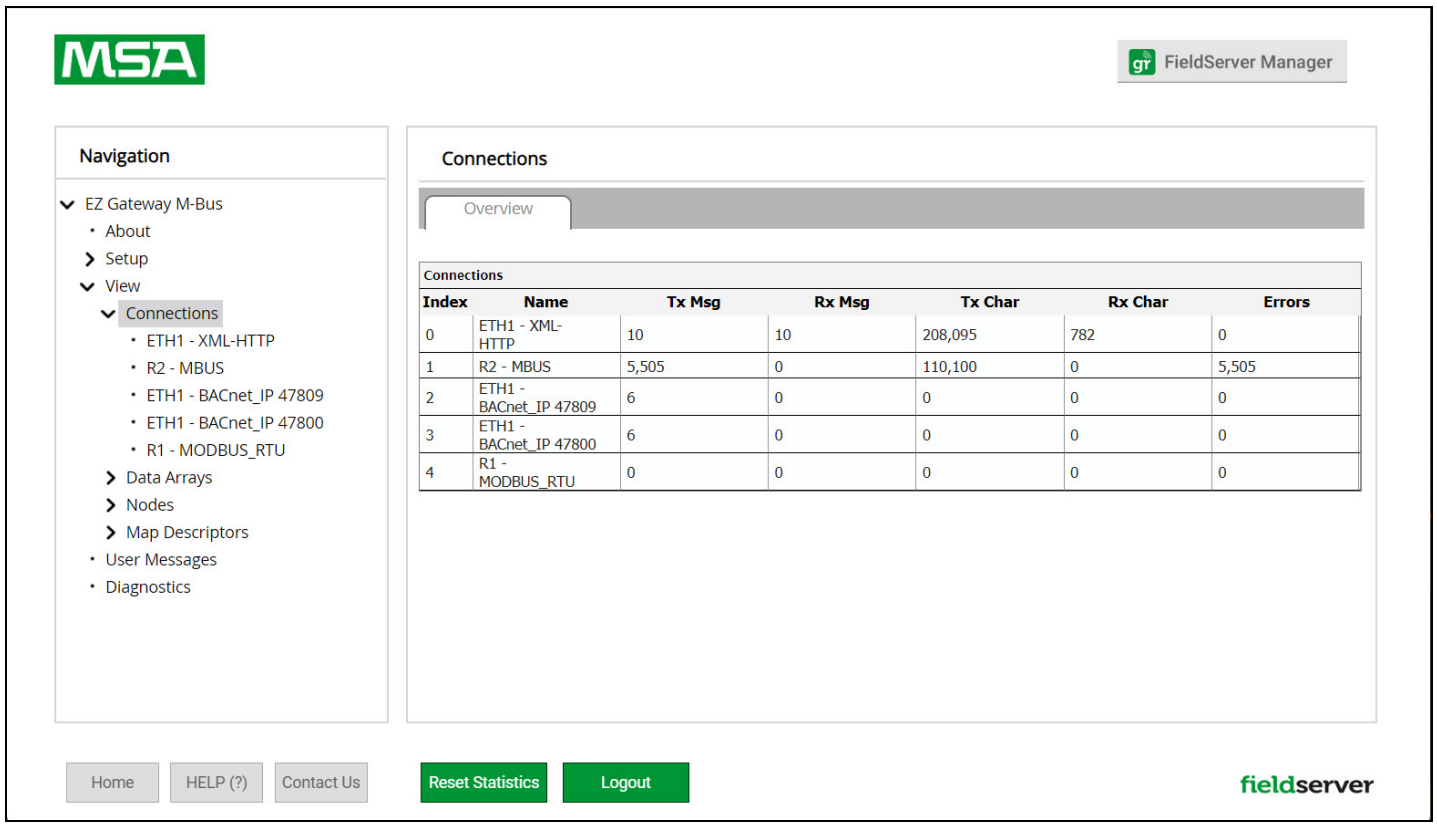

NOTE: For troubleshooting assistance refer to Section 8 Troubleshooting, or any of the troubleshooting appendices in the related driver supplements and configuration manual. MSA Safety also offers a technical support on the MSA Safety website, which contains a significant number of resources and documentation that may be of assistance.

7.6.1 Accessing the FieldServer Manager

NOTE: The FieldServer Manager tab 

(see image above) allows users to connect to the Grid, MSA Safety's device cloud solution for IIoT. The FieldServer Manager enables secure remote connection to field devices through a FieldServer and its local applications for configuration, management, maintenance. For more information about the FieldServer Manager, refer to the MSA Grid - FieldServer Manager Start-up Guide.

8 Troubleshooting

8.1 Communicating with the EZ Gateway Over the Network

- Confirm that the network cabling is correct.
- Confirm that the computer network card is operational and correctly configured.
- Confirm that there is an Ethernet adapter installed in the PC's Device Manager List, and that it is configured to run the TCP/IP protocol.
- Check that the IP netmask of the PC matches the EZ Gateway. The Default IP Address of the EZ Gateway is 192.168.2.X, Subnet Mask is 255.255.255.0.
  - Go to Start|Run
  - Type in "ipconfig"
  - The account settings should be displayed
  - Ensure that the IP Address is 102.168.2.X and the netmask 255.255.255.0
- Ensure that the PC and EZ Gateway are on the same IP Network, or assign a Static IP Address to the PC on the 192.168.2.X network.

8.2 Notes Regarding Subnets and Subnet Masks


RFC standards allocate the IP Address range of 192.0.0.0 through to 223.255.255.255 to be used in Class-C subnetting (subnets listed as 255.255.255.xxx, where xxx can vary based on filtering required).

Consequently, the IP stack for this product will not allow any IP Addresses in this range to be allocated a subnet that does not fall within the Class C range.

8.3 Taking a FieldServer Diagnostic Capture

When there is a problem on-site that cannot easily be resolved, perform a Diagnostic Capture before contacting support. Once the Diagnostic Capture is complete, email it to technical support. The Diagnostic Capture will accelerate diagnosis of the problem.

- Access the FieldServer Diagnostics page via one of the following methods:
  - Open the FieldServer FS-GUI page and click on Diagnostics in the Navigation panel
  - Open the FieldServer Toolbox software and click the diagnose icon of the desired device

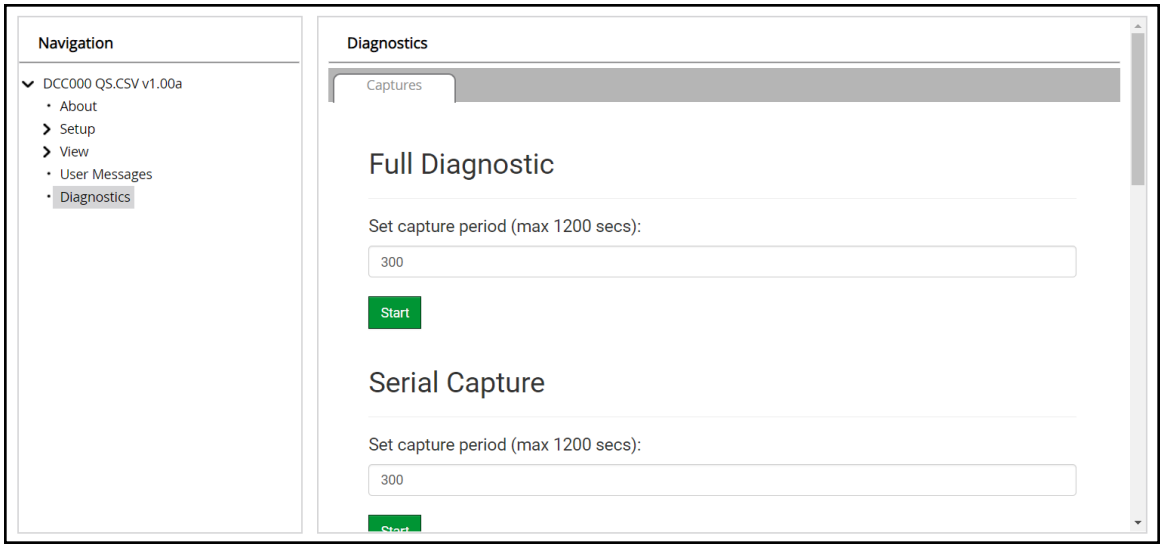

- Go to Full Diagnostic and select the capture period.
- Click the Start button under the Full Diagnostic heading to start the capture.
  - When the capture period is finished, a Download button will appear next to the Start button



- Click Download for the capture to be downloaded to the local PC.
- Email the diagnostic zip file to technical support (smc-support.emea@msasafety.com).

NOTE: Diagnostic captures of BACnet MS/TP communication are output in a ".PCAP" file extension which is compatible with Wireshark.

8.4 LED Functions



Light	Description
SPL	SPL LED will be on when a configured node in the EZ Gateway is detected as being offline. For details, check the FS-GUI Node overview screen in FS-GUI (click “View” then “Nodes”).
RUN	RUN LED will flash 20 seconds after power up, signifying normal operation. The EZ Gateway will be able to access theWeb App (refer to **Section 4.3 Access EZ Gateway Using a Web Browser** for more information) once this LED starts flashing. During the first 20 seconds, the LED should be off.
ERR	The ERR LED will go on solid 15 seconds after power up. It will turn off after 5 seconds. A steady red light will indicate there is a system error on the FieldServer. If this occurs, immediately report the related “system error” shown in the error screen of the FS-GUI interface to FieldServer support for evaluation.
RX	On normal operation, the RX LED will flash when a message is received on the field port.
TX	On normal operation, the TX LED will flash when a message is sent on the field port.
PWR	This is the power light. It should always show a steady green light when powered.

8.5 Internet Browser Software Support

The following web browsers are supported:

- Chrome Rev. 57 and higher
- Firefox Rev. 35 and higher
- Microsoft Edge Rev. 41 and higher
- Safari Rev. 3 and higher

NOTE: Internet Explorer is no longer supported as recommended by Microsoft.

NOTE: Computer and network firewalls must be opened for Port 80 to allow FieldServer GUI to function.

8.6 Stalled Discovery

Symptom: When performing a discovery, the progress bar should go from 0% to fully discovered gradually and increase at regular increments (the time this takes depends on how much there is to discover). A stalled discovery can be identified when the discovery progress decreases to a lower percentage value and the discovery progress bar stops loading for an extended period of time.

Cause: When this issue occurs, the progress bar value initially increases because a slave device that was queried does reply. However, the value of the progress bar then goes down because the data request from the slave device was unsuccessful. The EZ Gateway then continues to try to discover other addresses, but the progress bar remains stuck at the lower value.


Resolution: Wait for the discovery to complete. There is no timeframe for how long discovery can take because there are many factors that could prevent a slave device from sending data. Examples of these factors include: conflicting slave addresses, Secondary Addresses that are close in value to each other, and multiple devices responding at the same time. The user can check the status of the discovery process by accessing the FS-GUI page: click the word “Diagnostics” on the bottom of the EZ Gateway landing page, navigate to User Messages, and then click the Driver tab. Scroll to the bottom to see the latest messages from the gateway.

9 Additional Information


9.1 Change Web Server Security Settings After Initial Setup

NOTE: Any changes will require a FieldServer reboot to take effect.

- Navigate from the EZ Gateway landing page to the FS-GUI by clicking the blue “Diagnostics” text on the bottom of the screen.

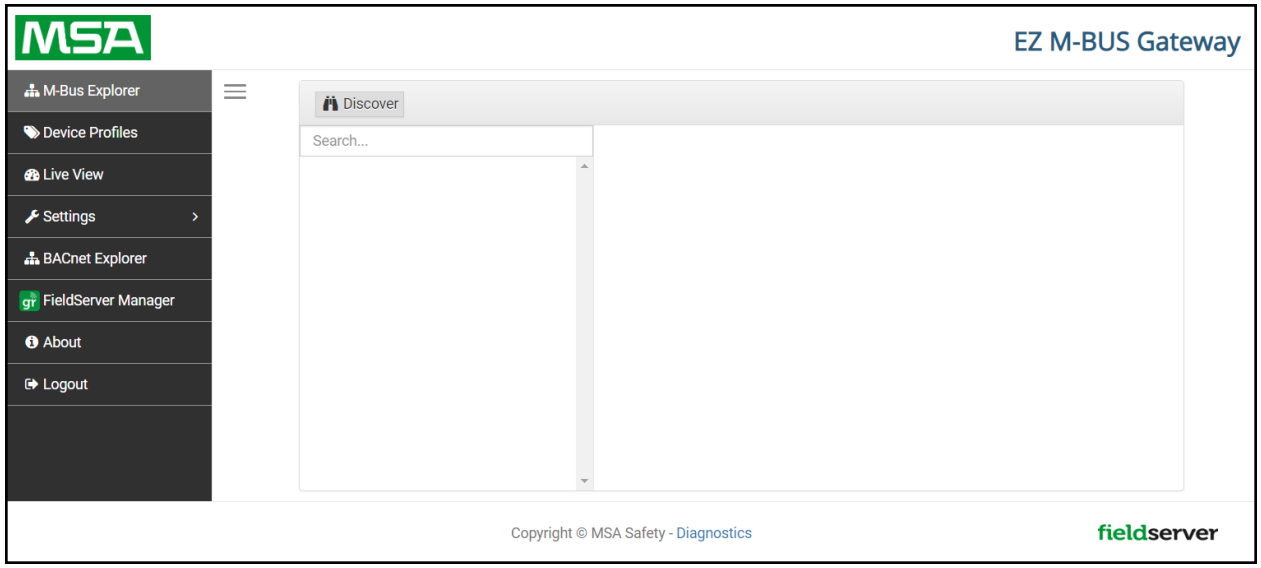


- Click Setup in the Navigation panel.

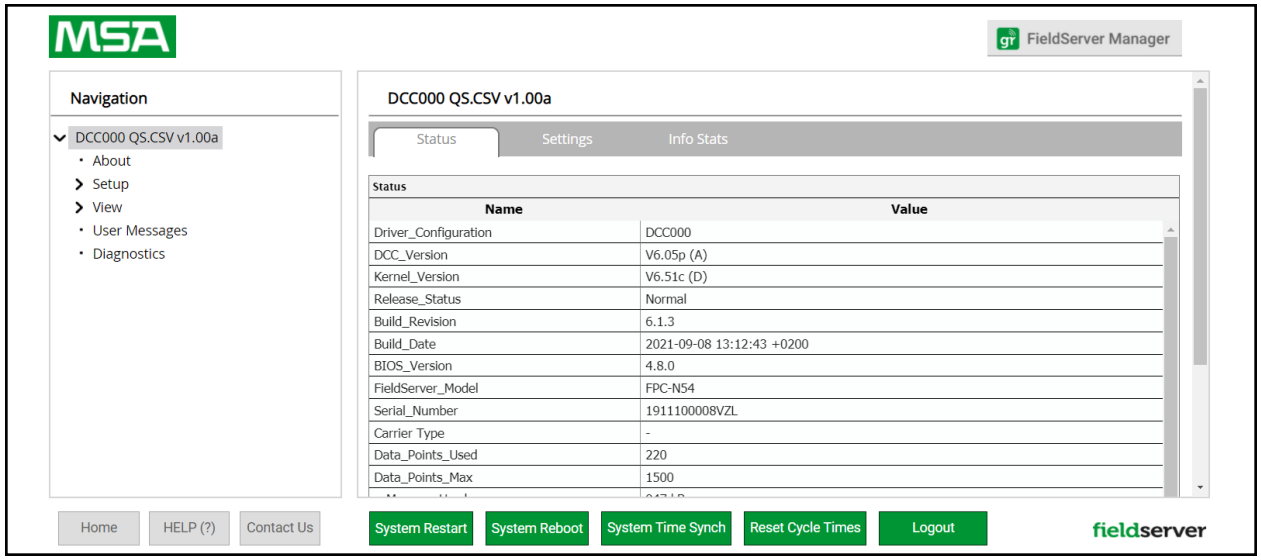

9.1.1 Change Security Mode

- Click Security in the Navigation panel.

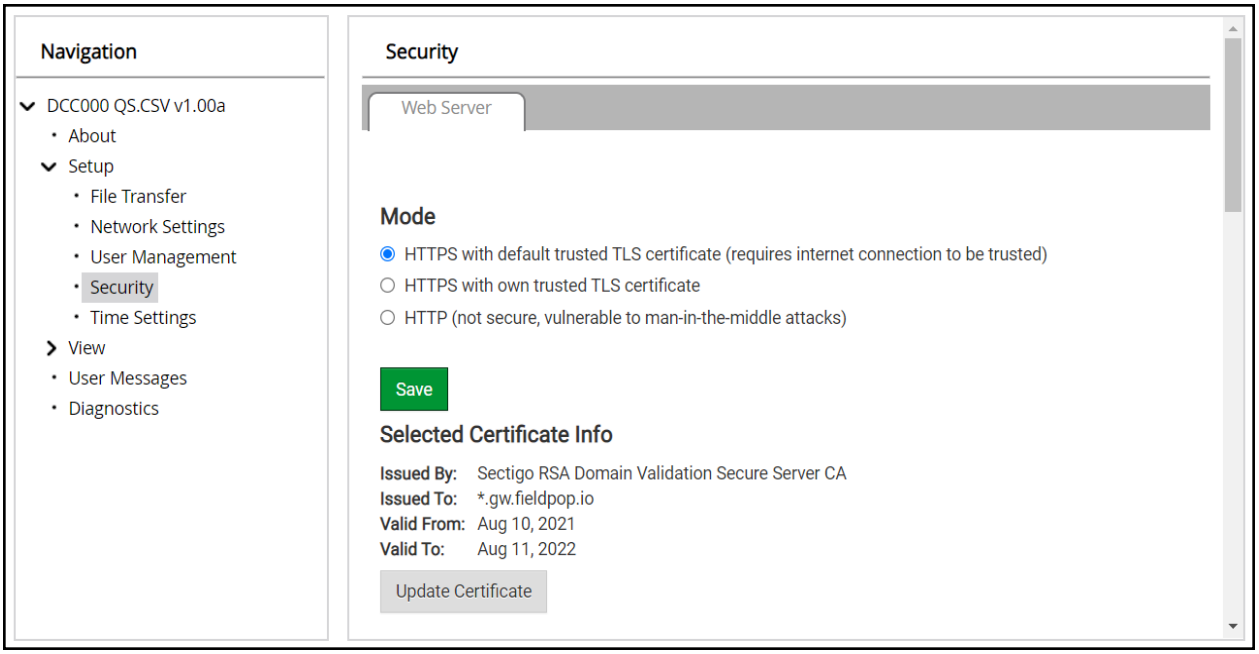


- Click the Mode desired.
  - If HTTPS with own trusted TLS certificate is selected, follow instructions in **Section 5.2.1 HTTPS with Own Trusted TLS Certificate**
- Click the Save button.

9.1.2 Edit the Certificate Loaded onto the FieldServer

NOTE: A loaded certificate will only be available if the security mode was previously setup as HTTPS with own trusted TLS certificate.

- Click Security in the Navigation panel.

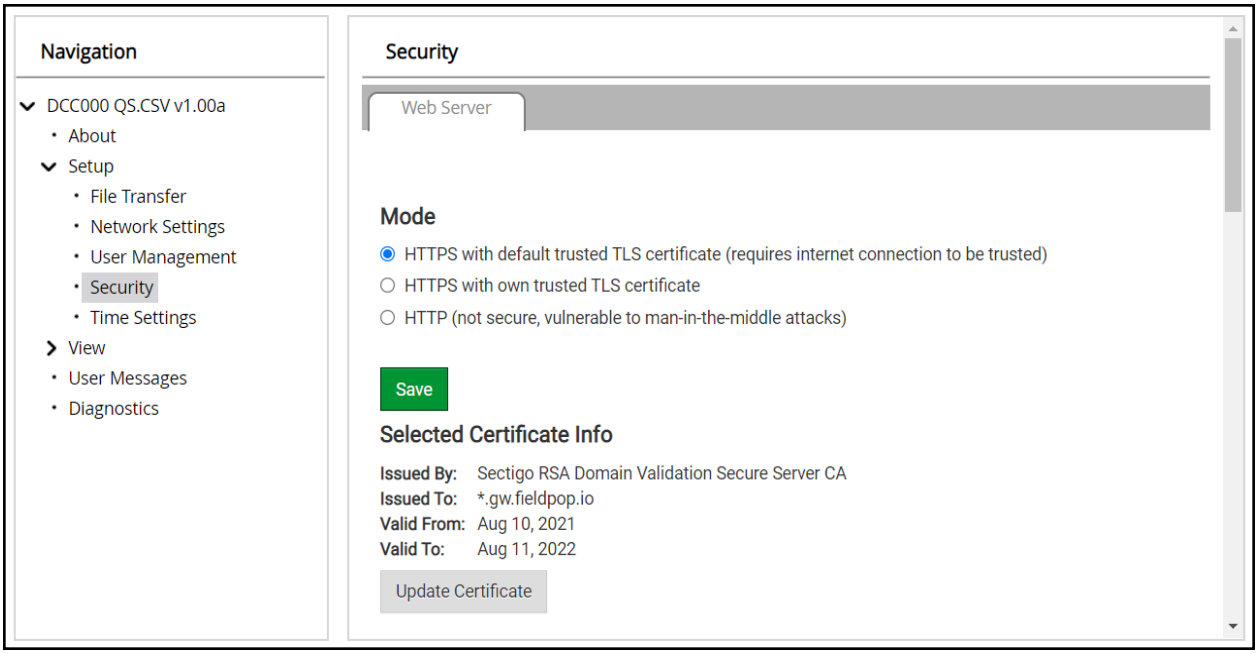

- Click the Edit Certificate button to open the certificate and key fields.
- Edit the loaded certificate or key text as needed and click Save.


9.2 Change User Management Settings

- From the FS-GUI page, click Setup in the Navigation panel.
- Click User Management in the navigation panel.

NOTE: If the passwords are lost, the unit can be reset to factory settings to reinstate the default unique password on the label. For recovery instructions, see the . If the default unique password is lost, then the unit must be mailed back to the factory.

NOTE: Any changes will require a FieldServer reboot to take effect.

- Check that the Users tab is selected.

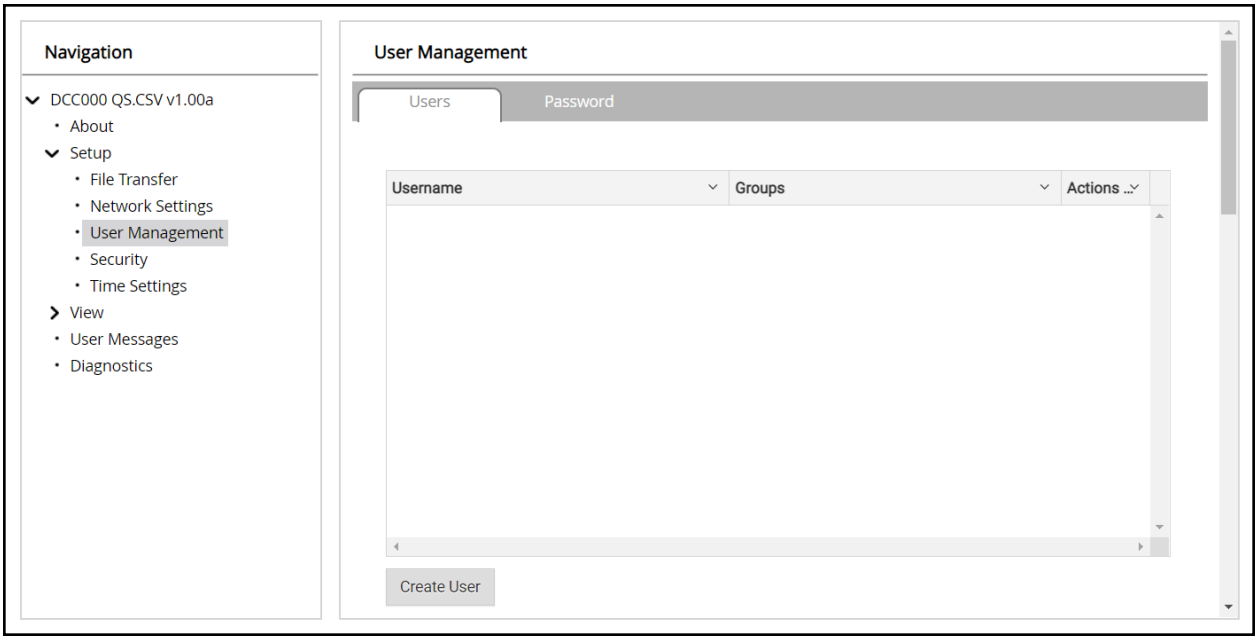

User Types:


Admin – Can modify and view any settings on the FieldServer.

Operator – Can modify and view any data in the FieldServer array(s).

Viewer – Can only view settings/readings on the FieldServer.

9.2.1 Create Users

- Click the Create User button.

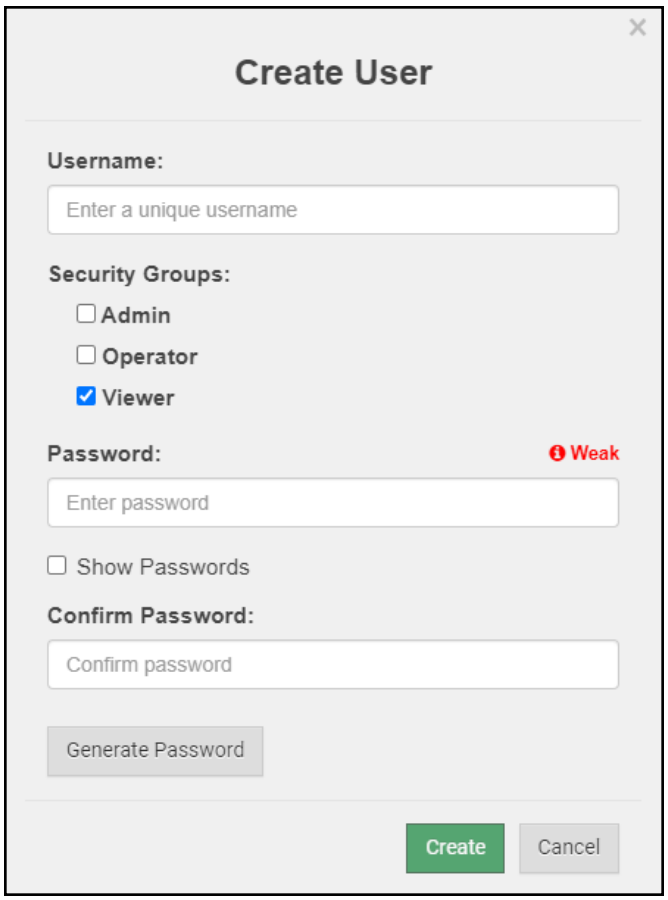


- Enter the new User fields: Name, Security Group and Password.
  - **User details are hashed and salted**

NOTE: The password must meet the minimum complexity requirements. An algorithm automatically checks the password entered and notes the level of strength on the top right of the Password text field.


- Click the Create button.
- Once the Success message appears, click OK.

9.2.2 Edit Users

- Click the pencil icon next to the desired user to open the User Edit window.

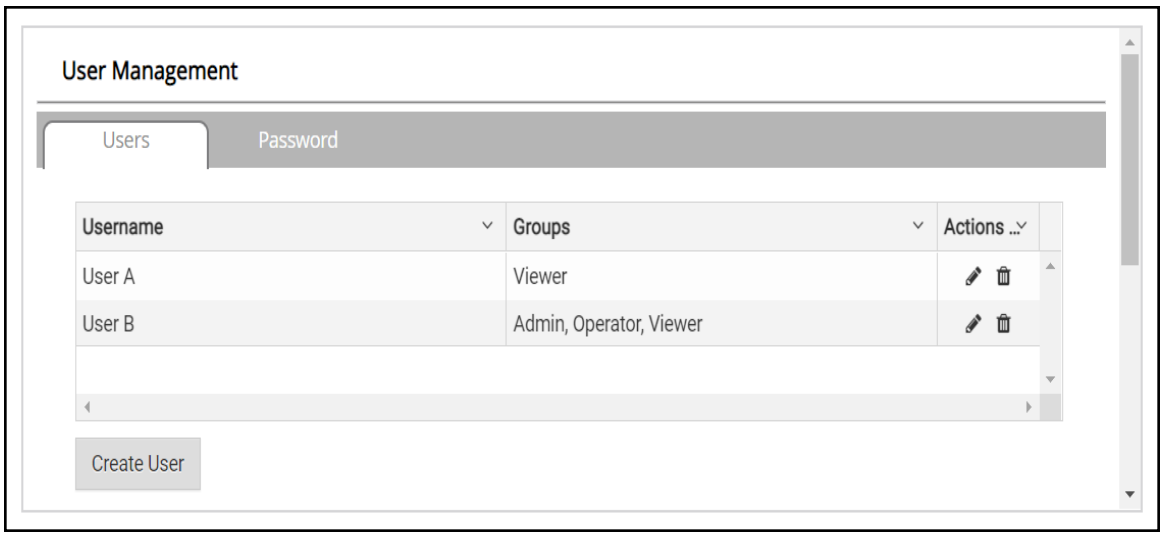


- Once the User Edit window opens, change the User Security Group and Password as needed.

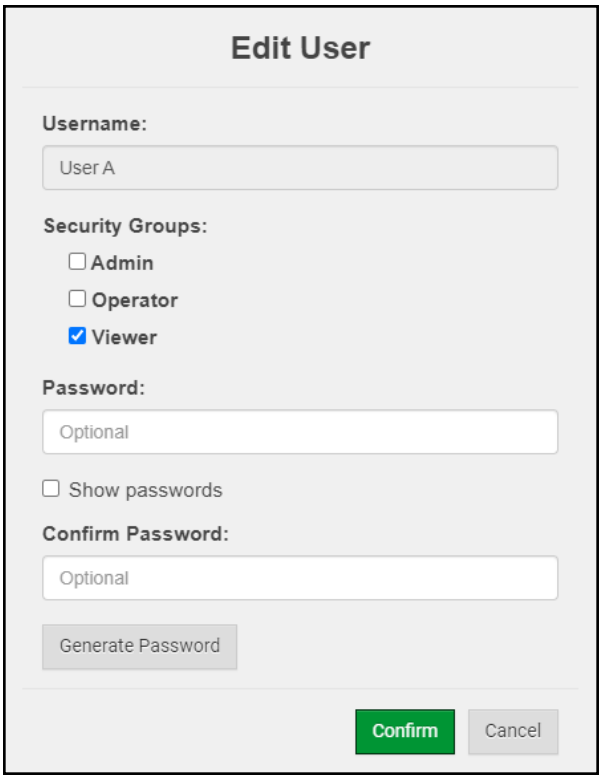


- Click Confirm.
- Once the Success message appears, click OK.

9.2.3 Delete Users

- Click the trash can icon next to the desired user to delete the entry.

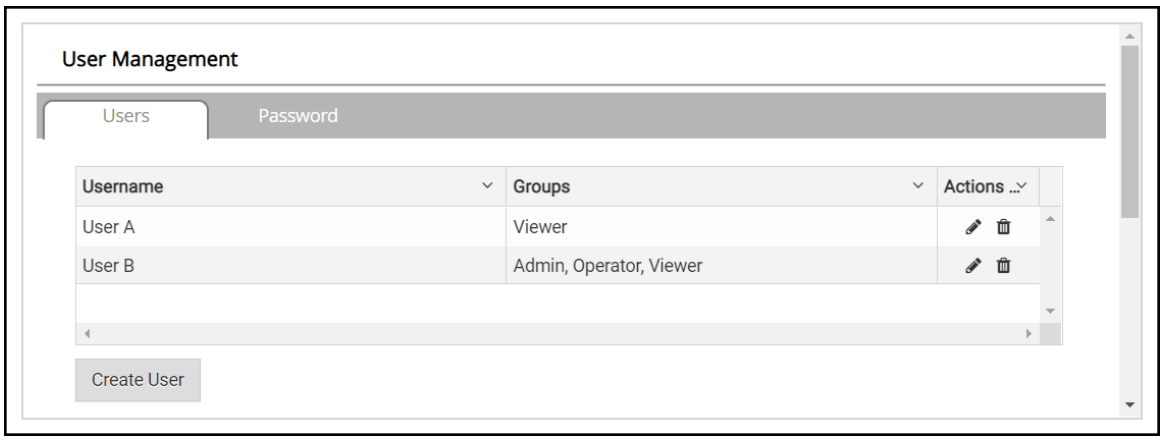


- When the warning message appears, click Confirm.

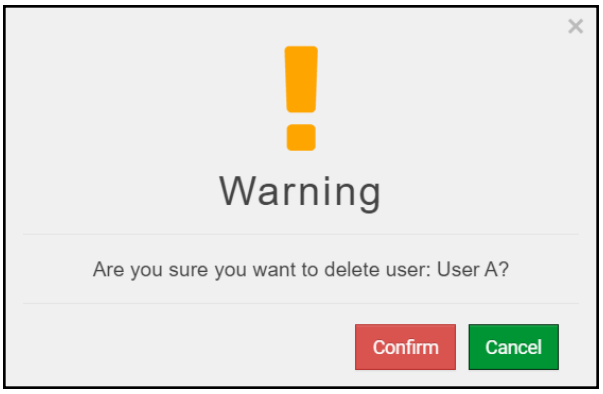

9.2.4 Change FieldServer Password

- Click the Password tab.

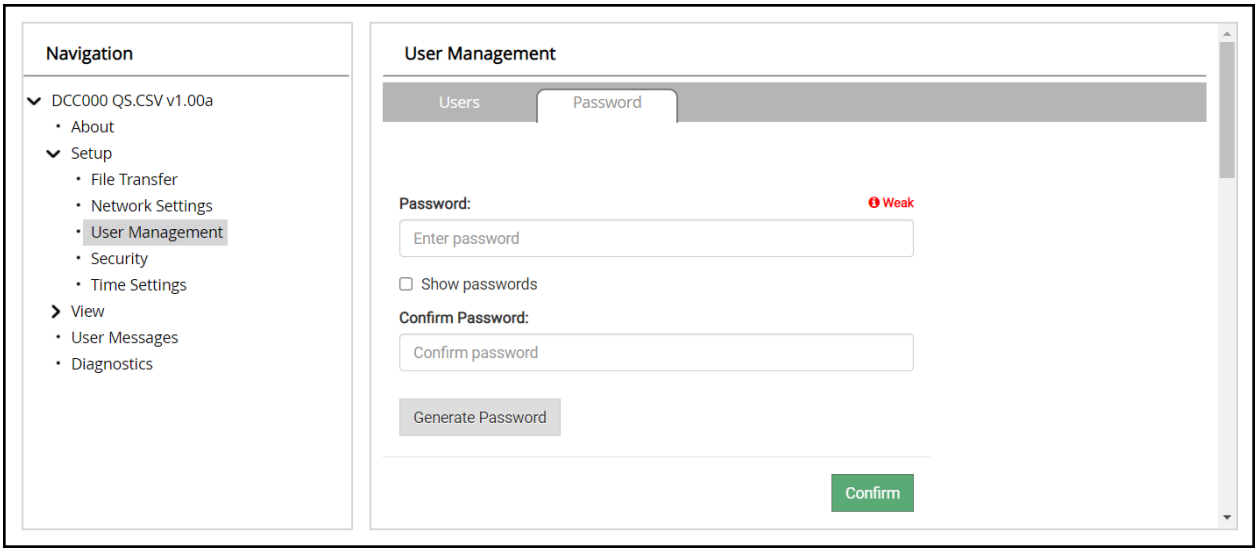

- Change the general login password for the FieldServer as needed.

NOTE: The password must meet the minimum complexity requirements. An algorithm automatically checks the password entered and notes the level of strength on the top right of the Password text field.

9.3 Specifications

	FS-EZX-MBUS-MD-BAC
Electrical Connections	One 6-pin Phoenix connector with: KNX port (+ / - / No Connection) Power port (+ / - / Frame-gnd) One 3-pin Phoenix connector with: RS-485 (+ / - / gnd) One Ethernet 10/100 BaseT port
Power Requirements	*Input Voltage:* 12-30VDC or 12-24VAC *Input Power Frequency:* 50/60 Hz. *Max Power:* 9.5 Watts
Approvals	UL 62368-1, CAN/CSA C22.2 No. 62368-1, EN IEC 62368-1, FCC Part 15, BTL marked, WEEE compliant, RoHS compliant, REACH compliant, UKCA and CE compliant, CAN ICES-003(A) / NMB-003(A)
Physical Dimensions	5.05 x 2.91 x 1.6 in. (12.82 x 7.39 x 4.06 cm) excluding mounting tabs
Weight	0.4 lbs (0.2 Kg)
Operating Temperature	-20 to 70°C (-4 to158°F)
Surge Suppression	EN61000-4-2 ESD EN61000-4-3 EMC EN61000-4-4 EFT
Humidity	5-90% RH (non-condensing)

Warning: This equipment is compliant with Class A of CISPR 32. In a residential environment, this equipment may cause radio interference.

NOTE: Specifications subject to change without notice.

9.4 Warnings

FCC Class A

NOTE: This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

9.5 Compliance with EN IEC 62368-1

For EN IEC compliance, the following instructions must be met when operating the EZ Gateway.

- Units shall be powered by listed LPS or Class 2 power supply suited to the expected operating temperature range.
- The interconnecting power connector and power cable shall:
  - Comply with local electrical code
  - Be suited to the expected operating temperature range
  - Meet the current and voltage rating for the FieldServer
- Furthermore, the interconnecting power cable shall:
  - Be of length not exceeding 3.05m (118.3”)
  - Be constructed of materials rated VW-1, FT-1 or better
- If the unit is to be installed in an operating environment with a temperature above 65 °C, it should be installed in a Restricted Access Area requiring a key or a special tool to gain access.
- This device must not be connected to a LAN segment with outdoor wiring.

10 Limited 2 Year Warranty

MSA Safety warrants its products to be free from defects in workmanship or material under normal use and service for two years after date of shipment. MSA Safety will repair or replace any equipment found to be defective during the warranty period. Final determination of the nature and responsibility for defective or damaged equipment will be made by MSA Safety personnel.

All warranties hereunder are contingent upon proper use in the application for which the product was intended and do not cover products which have been modified or repaired without MSA Safety's approval or which have been subjected to accident, improper maintenance, installation or application; or on which original identification marks have been removed or altered. This Limited Warranty also will not apply to interconnecting cables or wires, consumables or to any damage resulting from battery leakage.

In all cases MSA Safety's responsibility and liability under this warranty shall be limited to the cost of the equipment. The purchaser must obtain shipping instructions for the prepaid return of any item under this warranty provision and compliance with such instruction shall be a condition of this warranty.

Except for the express warranty stated above, MSA Safety disclaims all warranties with regard to the products sold hereunder including all implied warranties of merchantability and fitness and the express warranties stated herein are in lieu of all obligations or liabilities on the part of MSA Safety for damages including, but not limited to, consequential damages arising out of/or in connection with the use or performance of the product.